

#### UNITED STATES ENVIRONMENTAL PROTECTION AGENCY

## REGION 4 ATLANTA FEDERAL CENTER 61 FORSYTH STREET ATLANTA, GEORGIA 30303-8960

MAR = 1 7 2015

MAR 1 2 2015

## CERTIFIED MAIL 7010 1060 0002 1703 9331 RETURN RECEIPT REQUESTED

Mr. Michael Patrick, P.E. Director, Waste Resources Division City of Chattanooga 455 Moccasin Bend Road Chattanooga, Tennessee 37405


Re: Review of the Pump Station Preventive Maintenance Program

U.S. District Court Civil Action 1:12-cv-00245

Dear Mr. Patrick:

The U.S. Environmental Protection Agency Region 4 and the Tennessee Department of Environment and Conservation (TDEC) have reviewed the Pump Station Preventive Maintenance Program (PSPMP) for the City of Chattanooga (the City) pursuant to Section VI.20.f of the subject Consent Decree above. The EPA and TDEC hereby approve the PSPMP pending changes reflective of the following comments.

- 1. <u>Section 3.3</u>: Section VI.20.f.iv.B of the Consent Decree above requires the PSPMP repair component include a prioritized inventory of pump stations in need of repair.
- 2. <u>Section 3.3</u>: Section VI.20.f.iv.C of the Consent Decree above requires the PSPMP repair component include an ongoing inventory of completed repairs.
- 3. <u>Section 3.3</u>: Section VI.20.f.iv.D of the Consent Decree above requires the PSPMP repair component include a work schedule for repairs.
- 4. The EPA recommends including a signature page to catalog when the PSPMP was reviewed, if any revisions were made, and what the revisions were.

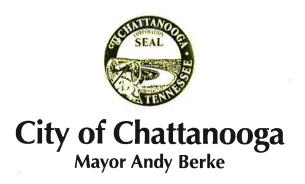

May 26, 2015

VIA CERTIFIED MAIL

Mrs. Sara Schiff Janovitz Environmental Engineer Clean Water Enforcement Branch US EPA - Region 4 61 Forsyth Street, SW Atlanta, GA 30303

Subject: United States of America et. al. v. City of Chattanooga, No. 1:12-cv-00245

Pump Station Preventive Maintenance Program – Resubmittal

Dear Mrs. Janovitz:

On behalf of the City of Chattanooga, Tennessee ("City"), and in accordance with the Consent Decree entered by the United States District Court for the Eastern District of Tennessee (Southern Division), on April 24, 2013, in the case styled the *United States of America et. al. v. City of Chattanooga, No. 1:12-cv-00245* ("Consent Decree"), we are resubmitting to both the Environmental Protection Agency ("EPA") and the Tennessee Department of Environment and Conservation ("TDEC") the Pump Station ("PS") Preventive Maintenance Program ("PS PMP") in response to comments from the EPA dated March 12, 2015.

The comments received from the EPA and the responses and corrections made to the PS PMP are as follows:

- 1. EPA Comment Section 3.3: Section VI.20.f.iv.B of the Consent Decree above requires the PSPMP repair component include a prioritized inventory of pump stations in need of repair.
  - <u>City of Chattanooga Response:</u> The following language has been added to Section 3.3.1, Guidance for Prioritization, "A list of current work orders for pump stations in need of repair and a list of completed repairs have been added to Appendix I and J, respectively."
- 2. <u>EPA Comment Section 3.3:</u> Section VI.20.f.iv.B of the Consent Decree above requires the PSPMP repair component include an ongoing inventory of completed repairs.

City of Chattanooga Response: See response to EPA Comment #1.

Mrs. Sara Schiff Janovitz May 26, 2015 Page Two

3. <u>EPA Comment Section 3.3:</u> Section VI.20.f.iv.B of the Consent Decree above requires the PSPMP repair component include a work schedule for repairs.

<u>City of Chattanooga Response:</u> According to Section 3.3.2, Scheduling Guidelines, repairs are scheduled using work order priority. The City's maintenance planners continually review this information to make sure they stay on schedule. The list of pump stations in need of repair, added in response to EPA Comment #1, includes work order priorities that indicate which repairs will be performed first. The flow associated with a particular pump station is also a factor.

4. <u>EPA Comment:</u> The EPA recommends including a signature page to catalog when the PSPMP was reviewed, if any revisions were made, and what the revisions were.

<u>City of Chattanooga Response:</u> A Review Approval Signature Page has been added.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering such information, the information submitted is, to the best of my knowledge and belief, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

We look forward to receiving EPA's and TDEC's approval of the PS PMP. In the meantime, please let me know if you have any questions regarding our submittal.

Sincerely,

Michael C. Patrick, P.E.

lad C. to

Director, Waste Resources Division

Enclosure

cc: Karl Fingerhood, Esq., US DOJ

Chief, Environmental Enforcement Section, US DOJ

Chief, Clean Water Enforcement Branch, US EPA Region 4

Bill Bush, Esq., US EPA

Phillip Hilliard, Office of the Attorney General

Enforcement Coordinator, Water Pollution Control, TDEC

Stephanie Durman, Esq., TCWN

Mike Marino, PE. Jacobs

Adam Sowatzka, Esq., King & Spalding



#### City of Chattanooga Waste Resources Division Consent Decree Program

## **Document Review Approval**

**Document: Pump Station Preventive Maintenance Program Revision Number:** This document has been reviewed and is approved for release. Reviewer: Date: \_\_\_\_\_ Signature: Reviewer: \_\_\_\_\_ Signature: \_\_\_\_ Date: Reviewer: Date: Signature: Reviewer: Date: \_\_\_\_\_ Signature: HA Y'VY Ub[ Yg'UfY`]ghYX'VY'ck"



## Pump Station Preventive Maintenance Program

Prepared for

# United States Environmental Protection Agency and Tennessee Department of Environment and Conservation

City of Chattanooga Waste Resources Division Consent Decree Program Case No. 1:12-cv-00245

Prepared by



**Brown and Caldwell** 

Submitted by



Jacobs Engineering Group Inc.
Consent Decree Program Manager

Chattanooga, Tennessee

November 18, 2014 Revised May 26, 2015

## Contents

| 1.0 | Intr | oduction  | 1  |
|-----|------|---|----|
| 1.1 | Р    | urpose  | 1  |
| 1.2 | В    | ackground   | 10 |
| 1.3 | R    | e-Evaluation of Existing PS and CSOTF Preventive Maintenance    | 11 |
| 1.4 | G    | oals  | 11 |
| 1.5 | A    | uthority  | 11 |
| 1.6 | D    | escription of the Wastewater Collection and Transmission System | 11 |
| 2.0 | Pro  | gram Documentation  | 13 |
| 3.0 | Des  | scription of Program  | 15 |
| 3.1 | P    | reventive Maintenance Schedule                                  | 16 |
| 3   | .1.1 | Electrical Preventive Maintenance                               | 16 |
| 3   | .1.2 | Mechanical Preventive Maintenance                               | 19 |
| 3   | .1.3 | Physical Preventive Maintenance                                 | 19 |
| 3.2 | St   | andard Inspection Forms   | 19 |
| 3.3 | R    | eactive Component   | 20 |
| 3   | .3.1 | Guidance for Prioritization                                     | 20 |
| 3   | .3.2 | Scheduling Guidelines   | 20 |
| 3   | .3.3 | Corrective Maintenance Tracking                                 | 21 |
| 4.0 | Res  | source Management   | 22 |
| 4.1 | Р    | ersonnel  | 22 |
| 4   | .1.1 | Electrical Maintenance Personnel                                | 22 |
| 4   | .1.2 | Mechanical Maintenance Personnel                                | 23 |
| 4   | .1.3 | Physical Maintenance Personnel                                  | 23 |
| 4.2 | S    | CADA Maintenance  | 24 |
| 5.0 | Per  | formance Measures   | 25 |
| 6.0 | Per  | iodic Evaluation/Continuous Improvement                         | 26 |
| 6.1 | Р    | eriodic Evaluation  | 26 |
| 6.2 | C    | ontinuous Improvement Initiatives                               | 26 |

|     | 6.2.1   | Checklist Enhancements and Use  | .26  |
|-----|---------|---|------|
|     | 6.2.2   | Fully Implement and Monitor KPIs                                      | .26  |
|     | 6.2.3   | Develop a Program to Locate and Maintain Air Relief Valves            | .26  |
|     | 6.2.4   | Continue the Development and Refinement of PM Work Orders             | .27  |
|     | 6.2.5   | Capacity Management Operations and Maintenance (CMOM) Development     | .27  |
| Apı | oendice | es  |      |
| Α   | Woı     | rk Order Flow Charts  |      |
| В   | Exa     | mple of PS Electrical Inspection and Preventive Maintenance Checklist |      |
| С   | Exa     | mple of PS Mechanical Inspection and Preventive Maintenance Checklist |      |
| D   | Exa     | mple of PS Physical Inspection and Preventive maintenance Checklist   |      |
| Е   | Exa     | mple of PS Electrical Inspection Report                               |      |
| F   | Exa     | mple of PS Mechanical Inspection Report                               |      |
| G   | Exa     | mple of PS Physical Inspection Report                                 |      |
| Н   | Was     | ste Resources Division Organizational Chart                           |      |
| I   | Cur     | rent PS and CSOTF Work Orders   |      |
| J   | Con     | npleted PS and CSOTF Work Orders                                      |      |
| Tak | oles    |   |      |
| 1-1 | City    | of Chattanooga Wastewater PSs and CSOTFs                              | 2-5  |
| 1-2 | Grir    | nder Pump List6   | -10  |
| 3-1 | Flov    | v Meter List17  | -19  |
| 5-1 | KPI     | s for PSs and CSOTFs  | . 25 |

## **Acronyms and Abbreviations**

CM Corrective Maintenance (or corrective maintenance work order)

CMMS Computerized Maintenance Management System

CMOM Capacity Management Operations and Maintenance

CSO Combined Sewer Overflow

CSOTF Combined Sewer Overflow Treatment Facility

DPW Department of Public Works

EMRIP Equipment Maintenance and Reliability Improvement Program

EPA Environmental Protection Agency

ERP Emergency Response Plan

ISS Interceptor Sewer System

KPI Key Performance Indicator

MBWWTP Moccasin Bend Wastewater Treatment Plant

O&M Operations and Maintenance

PER Preliminary Engineering Report

PM Preventive Maintenance (or preventive maintenance work order)

PS Pump PS

SCADA Supervisory Control and Data Acquisition

SOP Standard Operating Procedure

SSO Sanitary Sewer Overflow

SORP Sewer Overflow Response Plan

TDEC Tennessee Department of Environment and Conservation

VFD Variable Frequency Drive

WCTS Wastewater Collection and Transmission System

WIMS Water Information Management System

WO Work Order

WRD Waste Resources Division
WWTP Wastewater Treatment Plan

## 1.0 Introduction

## 1.1 Purpose

On April 24, 2013, the City of Chattanooga (City) entered into a consent decree with the United States and the State of Tennessee, in the case styled United States of American et. Al. v. City of Chattanooga, No. 1:12-cv-00245 (CD). The City's, Waste Resources Division (WRD) has prepared this Pump Station (PS) Preventive Maintenance Program for review and approval by the United States Environmental Protection Agency (EPA) and the Tennessee Department of Environment and Conservation (TDEC), as a condition of paragraph 20(c) of the CD.

The purpose of this PS Preventive Maintenance Program for the City of Chattanooga is to provide adequate guidelines to improve the reliability of operations at these facilities. PS and CSOTF availability and reliability is essential in the conveyance of wastewater, while reducing the risk of Sanitary Sewer Overflows (SSOs). Goals of this PS Preventative Maintenance Program include the following:

- Provide reliable and continuous service; and
- Minimize impacts to surrounding communities during service interruptions (e.g. power outages, etc.) and maximize the useful life of the equipment.

The goals will be accomplished through the following actions, among others, which are highlighted below and in the remainder of this document:

- Inspect and lubricate pumps and other mechanical equipment according to the manufacturers' recommendations.
- Verify the proper operation of the alarms, telemetry system, and auxiliary equipment.
- Develop specific job qualifications and make appropriate staff aware of the proper maintenance activities necessary at each PS and CSOTF.
- Utilize data and maintenance history to build preventive maintenance tasks that increase PS and CSOTF reliability and minimize down-time of equipment.
- Develop schedules for inspections, lubrication, and other tasks that provide appropriate intervals for the equipment within its working environment.
- Use data and history to predict and avoid equipment failures.

Table 1-1 lists the wastewater PSs and CSOTFs.

**Table 1-1**City of Chattanooga Wastewater PSs and CSOTFs

| Name                | Туре  | Location                       | City, State | Year in<br>Service | Wastewater Type                          | Pump<br>Nameplate<br>Rating (GPM) | Number<br>of Pumps | Operational<br>Visit Schedule |
|---------------------|-------|--------------------------------|-------------|--------------------|--|-----------------------------------|--------------------|-------------------------------|
| 19th St. CSO        | CSOTF | 1504 Riverfront Pky            | Chatt, TN   | 2001               | Combined                                 | N/A                               | N/A                | Monthly                       |
| 19th St. PS         | PS    | 1000 W. 19th St.               | Chatt, TN   | 1966               | Domestic,<br>Industrial, and<br>Combined | 7,000                             | 3                  | Weekly                        |
| 23rd St. PS         | PS    | 299 Poss Dr.                   | Chatt, TN   | 1955               | Domestic,<br>Industrial, and<br>Combined | 18,000                            | 4                  | Weekly                        |
| 26th St. PS         | PS    | 2600 Carr St.                  | Chatt, TN   | 1979               | Domestic                                 | 25                                | 2                  | Monthly                       |
| Airport Rd. #1 PS   | PS    | 5801 Rosedale Rd               | Chatt, TN   | 1971               | Domestic                                 | 800                               | 2                  | Monthly                       |
| Airport Rd. #2 PS   | PS    | 850 Jubilee Dr.                | Chatt, TN   | 2005               | Domestic, Industrial                     | 180                               | 2                  | Monthly                       |
| Altamont PS         | PS    | 2406 High Point Dr.            | Chatt, TN   | 1999-2000          | Domestic                                 | 50/500                            | 4                  | Monthly                       |
| Alton Park PS       | PS    | 3000 E. 34th St.               | Chatt, TN   | 1972               | Domestic                                 | 265                               | 2                  | Monthly                       |
| Arbor Creek PS      | PS    | 2701 Arbor Creek Way<br>(2543) | Hixson, TN  | 1989               | Domestic                                 | 150                               | 2                  | Monthly                       |
| Battery Place PS    | PS    | 501 Battery Place              | Chatt, TN   | 1985               | Domestic                                 | 300                               | 2                  | Monthly                       |
| Big Ridge No. 1 PS  | PS    | 5816 Lake Resort Dr.           | Hixson, TN  | 1995               | Domestic                                 | 950                               | 2                  | Monthly                       |
| Big Ridge No. 2 PS  | PS    | 4600 Gann Store Road           | Hixson, TN  | 1995               | Domestic                                 | 950                               | 2                  | Weekly                        |
| Big Ridge No. 3 PS  | PS    | 4714 Privateer Rd              | Hixson, TN  | 1995               | Domestic                                 | 80                                | 2                  | Monthly                       |
| Big Ridge No. 4 PS  | PS    | 4736 Privateer Rd              | Hixson, TN  | 1997               | Domestic                                 | 25                                | 2                  | Monthly                       |
| Big Ridge No. 5 PS  | PS    | 4802 Woodland Circle           | Hixson, TN  | 1995               | Domestic                                 | 550                               | 2                  | Weekly                        |
| Big Ridge No. 6 PS  | PS    | 1902 Wisteria Dr.              | Hixson, TN  | 1996               | Domestic                                 | 550                               | 2                  | Monthly                       |
| Big Ridge No. 7 PS  | PS    | 2224 Rambler Ln. (2223)        | Hixson, TN  | 1997               | Domestic                                 | 25                                | 2                  | Monthly                       |
| Big Ridge No. 8 PS  | PS    | 2226 Wisteria Dr. (2200)       | Hixson, TN  | 1997               | Domestic                                 | 25                                | 2                  | Monthly                       |
| Big Ridge No. 9 PS  | PS    | 6402 Lake Shadows Circle       | Hixson, TN  | 1997               | Domestic                                 | 25                                | 2                  | Monthly                       |
| Big Ridge No. 10 PS | PS    | 4029 Breakwater Dr.            | Hixson, TN  | 1997               | Domestic                                 | 25                                | 2                  | Monthly                       |
| Big Ridge No. 11 PS | PS    | 5733 Lake Resort Terrace       | Hixson, TN  | 1999               | Domestic                                 | 150                               | 2                  | Monthly                       |
| Big Ridge No. 12 PS | PS    | 5530 Lake Resort Terrace       | Hixson, TN  | 1999               | Domestic                                 | 180                               | 2                  | Monthly                       |

**Table 1-1**City of Chattanooga Wastewater PSs and CSOTFs

| Name  | Туре  | Location                                | City, State    | Year in<br>Service | Wastewater Type                          | Pump<br>Nameplate<br>Rating (GPM) | Number<br>of Pumps | Operational<br>Visit Schedule |
|---|-------|---|----------------|--------------------|--|-----------------------------------|--------------------|-------------------------------|
| Big Ridge No. 13 PS                                   | PS    | 5596 Lake Resort Terrace                | Hixson, TN     | 1999               | Domestic                                 | 400                               | 2                  | Monthly                       |
| Big Ridge No. 14 PS                                   | PS    | 1965 Hixson Marina Rd.                  | Hixson, TN     | 2003               | Domestic                                 | 225                               | 2                  | Monthly                       |
| Boy Scout Rd. PS                                      | PS    | Boy Scout Rd.<br>816 (811 W. Boy Scout) | Hixson, TN     | 1992               | Domestic, Industrial                     | 2,570/3,150                       | 3                  | Weekly                        |
| Brainerd Golf Course PS                               | PS    | 409 Tacoa Ave.                          | Chatt, TN      | 1949               | Domestic                                 | 500                               | 2                  | Monthly                       |
| Brainerd Manor PS                                     | PS    | 4600 Ricky Dr.                          | Chatt, TN      | 1972               | Domestic                                 | 100                               | 2                  | Monthly                       |
| Carter St. CSO  | CSOTF | West 20th 500 Block                     | Chatt, TN      | 1998               | Combined                                 | N/A                               | N/A                | Monthly                       |
| Central Ave CSO                                       | CSOTF | 2700 Market St                          | Chatt, TN      | 2000               | Combined                                 | N/A                               | N/A                | Monthly                       |
| Citico CSO  | CSOTF | 201 Riverside Pky                       | Chatt, TN      | 2000               | Combined                                 | N/A                               | N/A                | Monthly                       |
| Citico PS   | PS    | 1004 Riverside Dr.                      | Chatt, TN      | 1999               | Domestic,<br>Industrial, and<br>Combined | 27,500                            | 4                  | Weekly                        |
| Collegedale PS  | PS    | 5205 Ooltewah Ringgold<br>Rd.           | Ooltewah, TN   | 1975               | Domestic, Industrial                     | 1,100                             | 4                  | Weekly                        |
| Davidson Place  | PS    | 1075 Dodie Dr.                          | Chatt, TN      | 2009               | Domestic                                 | 450                               | 2                  | Monthly                       |
| Dupont Industrial<br>Park/North Industrial<br>Park PS | PS    | 4500 Pinnacle Lane                      | Chatt, TN      | 1999               | Domestic                                 | 25                                | 2                  | Monthly                       |
| Dupont Parkway PS                                     | PS    | 1610 Elm St.                            | Hixson, TN     | 1995               | Domestic, Industrial                     | 4,500                             | 3                  | Monthly                       |
| East Brainerd PS                                      | PS    | Frawley Rd.                             | East Ridge, TN | 1978               | Domestic                                 | 2,250                             | 3                  | Weekly                        |
| East Gate #1 PS                                       | PS    | 5630 Brainerd Rd.                       | Chatt, TN      | 1963               | Domestic                                 | 200                               | 2                  | Monthly                       |
| East Gate #2 PS                                       | PS    | 220 Cornelison Rd                       | Chatt, TN      | 2007               | Domestic                                 | 500                               | 2                  | Monthly                       |
| ESIP / Enterprise                                     | PS    | 6705 Bonny Oaks Dr.                     | Chatt, TN      | 2004               | Industrial                               | 795                               | 2                  | Monthly                       |
| Fagan Street PS                                       | PS    | 3816 Fagan St.                          | Chatt, TN      | 1979               | Domestic                                 | 50                                | 2                  | Monthly                       |
| Friar Branch PS                                       | PS    | 3910 Juandale Dr.                       | Chatt, TN      | Built 1978         | Domestic, Industrial                     | 16,800                            | 3                  | Weekly                        |
| Heritage Green  | PS    | 653 Calloway Court                      | Chatt, TN      | 2005               | Domestic                                 | 60                                | 2                  | Monthly                       |
| Highland Park PS                                      | PS    | 2331 S. Holtzclaw Ave.                  | Chatt, TN      | 1995               | Domestic, Industrial                     | 4,500                             | 3                  | Monthly                       |

**Table 1-1**City of Chattanooga Wastewater PSs and CSOTFs

| Name                  | Type  | Location                                | City, State  | Year in<br>Service        | Wastewater Type      | Pump<br>Nameplate<br>Rating (GPM) | Number<br>of Pumps | Operational<br>Visit Schedule |
|-----------------------|-------|---|--------------|---------------------------|----------------------|-----------------------------------|--------------------|-------------------------------|
| Hixson No. 1 PS       | PS    | 4677 Adams Rd.                          | Hixson, TN   | 1980                      | Domestic             | 7,000                             | 3                  | Weekly                        |
| Hixson No. 2 PS       | PS    | Adams Rd. and Old Hixson<br>Pike (5401) | Hixson, TN   | 1980                      | Domestic             | 7,000                             | 3                  | Weekly                        |
| Hixson No. 3 PS       | PS    | 5234 Cassandra Smith Rd.                | Hixson, TN   | 1985                      | Domestic             | 7,000                             | 3                  | Weekly                        |
| Komatsu PS            | PS    | 400 Runyan Dr.                          | Hixson, TN   | 1987                      | Domestic, Industrial | 275                               | 2                  | Monthly                       |
| Lake Vista PS         | PS    | 4537 Peckinpaugh Dr.                    | Chatt, TN    | 1985                      | Domestic             | 132                               | 2                  | Monthly                       |
| Latta Street PS       | PS    | 1424 Latta St.                          | Chatt, TN    | 1973                      | Domestic             | 1,000                             | 2                  | Monthly                       |
| Manker Patten PS      | PS    | Manker Patten/Tennis<br>Courts          | Chatt, TN    | 2002                      | Domestic             | 46                                | 2                  | Monthly                       |
| Meadow Trace PS       | PS    | 4905 Meadow Trace                       | Hixson, TN   | 1992                      | Domestic             | 25                                | 2                  | Monthly                       |
| MLK CSO               | CSOTF | 1015 Riverfront Pky                     | Chatt, TN    | 2000                      | Combined             | N/A                               | N/A                | Monthly                       |
| Mountain Creek PS     | PS    | Baylor School Rd.                       | Chatt, TN    | 1971                      | Domestic, Industrial | 4,166                             | 2                  | Weekly                        |
| Murray Hills No. 1 PS | PS    | 4550 Webb Rd.                           | Chatt, TN    | 1994                      | Domestic             | 255                               | 2                  | Monthly                       |
| Murray Hills No. 2 PS | PS    | 4951 Bal Harbor Dr.                     | Chatt, TN    | 1994                      | Domestic             | 80                                | 2                  | Monthly                       |
| Murray Hills No. 3 PS | PS    | 4924 Bal Harbor Dr.                     | Chatt, TN    | 1994                      | Domestic             | 150                               | 2                  | Monthly                       |
| Murray Hills No. 4 PS | PS    | 3707 Kings Rd.                          | Chatt, TN    | 1994                      | Domestic             | 80                                | 2                  | Monthly                       |
| Murray Hills No. 5 PS | PS    | 3820 Kings Rd.                          | Chatt, TN    | 1994                      | Domestic             | 450                               | 2                  | Monthly                       |
| Orchard Knob WW PS    | PS    | 808 N. Holtzclaw                        | Chatt, TN    | 1976                      | Domestic, Industrial | 5,200                             | 3                  | Weekly                        |
| Pineville Rd PS       | PS    | 1138 Pineville Rd.                      | Chatt, TN    | 1971                      | Domestic             | 250                               | 2                  | Monthly                       |
| Ringgold              | PS    | 75 Christian Rd.                        | Ringgold, GA | 2007                      | Domestic, Industrial | 1,215                             | 2                  | Weekly                        |
| River Park 1          | PS    | 4301 Amnicola Hwy                       | Chatt, TN    |                           | Domestic             |                                   | 2                  | Monthly                       |
| River Park 2          | PS    | 4301 Amnicola Hwy                       | Chatt, TN    |                           | Domestic             |                                   | 2                  | Monthly                       |
| Ross Landing CSO      | CSOTF | 201 Riverfront Pky                      | Chatt, TN    | 1992                      | Combined             | N/A                               | N/A                | Monthly                       |
| South Chickamauga PS  | PS    | 4000 N. Hawthorne St.                   | Chatt, TN    | 1978,<br>Upgraded<br>1995 | Domestic, Industrial | 24,000                            | 4                  | Weekly                        |
| Somerville PS         | PS    | 110 Somerville Avenue                   | Chatt, TN    |                           | Domestic             |                                   | 2                  | *                             |

**Table 1-1**City of Chattanooga Wastewater PSs and CSOTFs

| Name                            | Type             | Location                                 | City, State         | Year in<br>Service | Wastewater Type      | Pump<br>Nameplate<br>Rating (GPM) | Number<br>of Pumps | Operational<br>Visit Schedule |
|---------------------------------|------------------|--|---------------------|--------------------|----------------------|-----------------------------------|--------------------|-------------------------------|
| Spring Creek PS                 | PS               | 250 Vero Beach Avenue                    | Rossville, GA       | 1999               | Domestic, Industrial | 5,000                             | 3                  | Weekly                        |
| Summit #1                       | PS               | 4238 Old Woodland Dr.                    | Chatt, TN           | 2009               | Sanitary             | 350                               | 2                  | Monthly                       |
| Tiftona No. 1 PS                | PS               | 1006 Browns Ferry Rd.                    | Chatt, TN           | 1984               | Domestic, Industrial | 3,030                             | 2                  | Weekly                        |
| Tiftona No. 2 PS                | PS               | 141 Browns Ferry Rd.                     | Chatt, TN           | 1984               | Domestic, Industrial | 2,260                             | 2                  | Weekly                        |
| Tiftona No. 3 PS                | PS               | 248 Aster Avenue                         | Chatt, TN           | 1985               | Domestic, Industrial | 1,760                             | 2                  | Weekly                        |
| Tiftona No. 4 PS                | PS               | 1305 Browns Ferry Rd.                    | Chatt, TN           | 1994               | Domestic             | 475                               | 2                  | Monthly                       |
| Tiftona No. 5 PS                | PS               | Browns Ferry Rd. and<br>1339 Burgess Rd. | Chatt, TN           | 1994               | Domestic             | 200                               | 2                  | Monthly                       |
| Tremont CSO                     | CSOTF            | 20 Tremont St                            | Chatt, TN           | 2000               | Combined             | N/A                               | N/A                | Monthly                       |
| VAAP PS                         | PS               | Hwy 58                                   | Chatt, TN           | 1998               | Domestic, Industrial | 780                               | 2                  | Monthly                       |
| Warner Park Storage<br>Facility | CSO /<br>Storage | 1254 E. 3rd St.                          | Chatt, TN           | 2008               | Combined             | 2,000                             | 2                  | Monthly                       |
| West Chickamauga                | PS               | 241 Lillian Dr.                          | Fort Oglethorpe, GA | 2009               | Domestic             | 999                               | 2                  | Monthly                       |
| Williams St. CSO                | CSOTF            | 2705 Williams St                         | Chatt, TN           | 2000               | Combined             | N/A                               | N/A                | Monthly                       |
| Willow Bend PS                  | PS               | 1645 Eucalyptus Dr.                      | Chatt, TN           | 1981               | Domestic             | 100                               | 2                  | Monthly                       |

<sup>\*</sup>Somerville PS is a duplex grinder PS and is not regularly visited by operations.

In addition, the City maintains grinder PSs located throughout the Interceptor Sewer System (ISS). A list of the grinder PSs is provided in Table 1-2.

**Table 1-2**Grinder PS List

| Address                | City        | State | ZIP   |
|------------------------|-------------|-------|-------|
| 2206 Rambler Ln.       | Hixson      | TN    | 37343 |
| 2121 Wisteria Dr.      | Hixson      | TN    | 37343 |
| 2017 Clematis Dr.      | Chattanooga | TN    | 37421 |
| 2217 Rambler Ln.       | Hixson      | TN    | 37343 |
| 2201 Wisteria Dr.      | Hixson      | TN    | 37343 |
| 2200 Wisteria Dr.      | Hixson      | TN    | 37343 |
| 2223 Rambler Ln.       | Chattanooga | TN    | 37407 |
| 2222 Rambler Ln.       | Hixson      | TN    | 37343 |
| 2206 Wisteria Dr.      | Chattanooga | TN    | 37402 |
| 2019 Clematis Dr.      | Hixson      | TN    | 37343 |
| 2020 Clematis Dr.      | Hixson      | TN    | 37343 |
| 2033 Clematis Dr.      | Hixson      | TN    | 37343 |
| 2111 Clematis Dr.      | Hixson      | TN    | 37343 |
| 2117 Clematis Dr.      | Hixson      | TN    | 37343 |
| 2133 Clematis Dr.      | Hixson      | TN    | 37343 |
| 4919 Bal Harbor Dr.    | Chattanooga | TN    | 37416 |
| 6504 Lake Shadows Cir. | Hixson      | TN    | 37343 |
| 6404 Lake Shadows Cir. | Hixson      | TN    | 37343 |
| 6508 Lake Shadows Cir. | Hixson      | TN    | 37343 |
| 6402 Lake Shadows Cir. | Hixson      | TN    | 37343 |
| 6528 Lake Shadows Cir. | Hixson      | TN    | 37343 |
| 2120 Clematis Dr.      | Hixson      | TN    | 37343 |
| 2137 Clematis Dr.      | Hixson      | TN    | 37343 |
| 6500 Lake Shadows Cir. | Hixson      | TN    | 37343 |
| 6400 Lake Shadows Cir. | Hixson      | TN    | 37343 |
| 1901 Crystal Lake Ln.  | Hixson      | TN    | 37343 |
| 5739 Browntown Rd.     | Chattanooga | TN    | 37415 |
| 5733 Browntown Rd.     | Chattanooga | TN    | 37415 |
| 6054 Browntown Rd.     | Chattanooga | TN    | 37415 |
| 2026 Marina cove Dr.   | Hixson      | TN    | 37343 |
| 2028 Marina cove Dr.   | Hixson      | TN    | 37343 |
| 503 Battery Pl.        | Chattanooga | TN    | 37403 |
| 726 Old Dallas Rd.     | Chattanooga | TN    | 37405 |
| 1931 Riverwood Dr.     | Hixson      | TN    | 37343 |
| 2003 Riverwood Dr.     | Hixson      | TN    | 37343 |
| 2027 Riverwood Dr.     | Hixson      | TN    | 37343 |

**Table 1-2**Grinder PS List

| Address                    | City        | State | ZIP   |
|----------------------------|-------------|-------|-------|
| 2015 Wisteria Dr.          | Hixson      | TN    | 37343 |
| 2024 Crescent Club Dr.     | Hixson      | TN    | 37343 |
| 5831 North Park Rd.        | Hixson      | TN    | 37343 |
| 4015 Creekwood Terrace Ln. | Chattanooga | TN    | 37421 |
| 2023 Riverwood Dr.         | Hixson      | TN    | 37343 |
| 2510 Crescent Club Dr.     | Hixson      | TN    | 37343 |
| 5827 North Park Rd.        | Hixson      | TN    | 37343 |
| 2051 Hamill Rd.            | Chattanooga | TN    | 37404 |
| 2117 Rambler Ln.           | Hixson      | TN    | 37343 |
| 2100 Wisteria Dr.          | Hixson      | TN    | 37343 |
| 2110 Rambler Ln.           | Hixson      | TN    | 37343 |
| 2207 Rambler Ln.           | Hixson      | TN    | 37343 |
| 2106 Wisteria Dr.          | Hixson      | TN    | 37343 |
| 2110 Wisteria Dr.          | Hixson      | TN    | 37343 |
| 6405 Lake Shadows Cir.     | Hixson      | TN    | 37343 |
| 6401 Lake Shadows Cir.     | Hixson      | TN    | 37343 |
| 6410 Middle Ridge Ln.      | Hixson      | TN    | 37343 |
| 6406 Middle Ridge Ln.      | Hixson      | TN    | 37343 |
| 6400 Middle Ridge Ln.      | Hixson      | TN    | 37343 |
| 1914 Crystal Lake Ln.      | Hixson      | TN    | 37343 |
| 6411 Middle Ridge Ln.      | Hixson      | TN    | 37343 |
| 6405 Middle Ridge Ln.      | Hixson      | TN    | 37343 |
| 1910 Crystal Lake Ln.      | Hixson      | TN    | 37343 |
| 6401 Middle Ridge Ln.      | Hixson      | TN    | 37343 |
| 1904 Crystal Lake Ln.      | Hixson      | TN    | 37343 |
| 4028 Breakwater Dr.        | Hixson      | TN    | 37343 |
| 4026 Breakwater Dr.        | Hixson      | TN    | 37343 |
| 4024 Breakwater Dr.        | Hixson      | TN    | 37343 |
| 4020 Breakwater Dr.        | Hixson      | TN    | 37343 |
| 2127 Clematis Dr.          | Hixson      | TN    | 37343 |
| 2129 Clematis Dr.          | Hixson      | TN    | 37343 |
| 2120 Wisteria Dr.          | Chattanooga | TN    | 37422 |
| 2105 Rambler Ln.           | Hixson      | TN    | 37343 |
| 3591 Kings Rd.             | Chattanooga | TN    | 37416 |
| 3589 Kings Rd.             | Chattanooga | TN    | 37416 |
| 3790 Queens Rd.            | Chattanooga | TN    | 37416 |

**Table 1-2**Grinder PS List

| Address              | City        | State | ZIP   |
|----------------------|-------------|-------|-------|
| 3635 Kings Rd.       | Chattanooga | TN    | 37416 |
| 3627 Kings Rd.       | Chattanooga | TN    | 37404 |
| 3611 Kings Rd.       | Chattanooga | TN    | 37416 |
| 3643 Kings Rd.       | Chattanooga | TN    | 37422 |
| 3759 Kings Rd.       | Cleveland   | TN    | 37311 |
| 3515 Rhoda Ln.       | Chattanooga | TN    | 37416 |
| 3517 Rhoda Ln.       | Chattanooga | TN    | 37416 |
| 4925 Bal Harbor Dr.  | Chattanooga | TN    | 37416 |
| 4923 Bal Harbor Dr.  | Chattanooga | TN    | 37416 |
| 4921 Bal Harbor Dr.  | Chattanooga | TN    | 37416 |
| 4935 Bal Harbor Dr.  | Chattanooga | TN    | 37416 |
| 4937 Bal Harbor Dr.  | Chattanooga | TN    | 37416 |
| 4904 Shoreline Dr.   | Chattanooga | TN    | 37416 |
| 4939 Bal Harbor Dr.  | Chattanooga | TN    | 37416 |
| 4923 Bal Harbor Cir. | Chattanooga | TN    | 37416 |
| 4921 Bal Harbor Cir. | Chattanooga | TN    | 37416 |
| 4906 Shoreline Dr.   | Chattanooga | TN    | 37416 |
| 4941 Bal Harbor Dr.  | Chattanooga | TN    | 37416 |
| 4919 Bal Harbor Cir. | Chattanooga | TN    | 37416 |
| 4917 Bal Harbor Cir. | Chattanooga | TN    | 37416 |
| 4910 Shoreline Dr.   | Chattanooga | TN    | 37416 |
| 4943 Bal Harbor Dr.  | Chattanooga | TN    | 37416 |
| 4945 Bal Harbor Dr.  | Chattanooga | TN    | 37416 |
| 4915 Bal Harbor Cir. | Chattanooga | TN    | 37416 |
| 3798 Kings Rd.       | Chattanooga | TN    | 37416 |
| 3785 Kings Rd.       | Chattanooga | TN    | 37416 |
| 3773 Kings Rd.       | Chattanooga | TN    | 37416 |
| 3775 Kings Rd.       | Chattanooga | TN    | 37416 |
| 3735 Kings Rd.       | Chattanooga | TN    | 37401 |
| 3707 Kings Rd.       | Chattanooga | TN    | 37416 |
| 3715 Kings Rd.       | Chattanooga | TN    | 37416 |
| 3733 Kings Rd.       | Chattanooga | TN    | 37422 |
| 3721 Kings Rd.       | Chattanooga | TN    | 37416 |
| 3731 Kings Rd.       | Chattanooga | TN    | 37406 |
| 11 Siskin Dr.        | Chattanooga | TN    | 37402 |
| 3780 Queens Rd.      | Chattanooga | TN    | 37416 |

**Table 1-2**Grinder PS List

| Address                    | City         | State | ZIP   |
|----------------------------|--------------|-------|-------|
| 4931 Bal Harbor Dr.        | Chattanooga  | TN    | 37416 |
| 4927 Bal Harbor Dr.        | Chattanooga  | TN    | 37416 |
| 401 Signal Mountain Rd.    | Chattanooga  | TN    | 37404 |
| 3810 Lake Vista Dr.        | Chattanooga  | TN    | 37416 |
| 3818 Lake Vista Dr.        | Chattanooga  | TN    | 37416 |
| 3724 Skylark Trl.          | Chattanooga  | TN    | 37416 |
| 3630 Faith Rd.             | Brentwood    | TN    | 37027 |
| 3732 Skylark Trl.          | Collegedale  | TN    | 37315 |
| 3740 Skylark Trl.          | Chattanooga  | TN    | 37416 |
| 4601 Tarpon Trl.           | Chattanooga  | TN    | 37416 |
| 4722 Tarpon Trl.           | Chattanooga  | TN    | 37416 |
| 4604 Lake Haven Dr.        | Chattanooga  | TN    | 37416 |
| 4124 Melinda Dr.           | Chattanooga  | TN    | 37416 |
| 4622 Paw Trl.              | Birchwood    | TN    | 37308 |
| 901 Siskin Dr.             | Chattanooga  | TN    | 37403 |
| 4013 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 4011 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 4009 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 4007 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 4017 Caine Ln.             | Chattanooga  | TN    | 37421 |
| 4017 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 4012 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 4005 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 4003 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 4008 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 4006 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 4004 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 4016 Creekwood Terrace Ln. | Chattanooga  | TN    | 37421 |
| 3939 Caine Ln.             | Chattanooga  | TN    | 37414 |
| 6834 Standifer Gap Rd.     | Chattanooga  | TN    | 37421 |
| 6810 Robin Dr.             | Chattanooga  | TN    | 37414 |
| 627 O Grady Dr.            | Chattanooga  | TN    | 37419 |
| 4600 Maria St.             | Chattanooga  | TN    | 37411 |
| 504 Hemphill Ave.          | Chattanooga  | TN    | 37411 |
| 402 S Seminole Dr.         | Chattanooga  | TN    | 37415 |
| 398 East View Dr.          | Rock Springs | GA    | 30739 |

**Table 1-2**Grinder PS List

| Address                    | City        | State | ZIP   |
|----------------------------|-------------|-------|-------|
| 450 S Crest Rd.            | Signal Mtn. | TN    | 37377 |
| 416 East View Dr.          | Chattanooga | TN    | 37404 |
| 913 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 906 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 916 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 912 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 910 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 898 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 911 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 896 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 909 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 995 Hurricane Creek Rd.    | Chattanooga | TN    | 37411 |
| 892 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 890 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 993 Hurricane Creek Rd.    | Chattanooga | TN    | 37421 |
| 899 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 897 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 893 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 891 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 885 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 915 Shady Fork Rd.         | Chattanooga | TN    | 37421 |
| 4002 Creekwood Terrace Ln. | Chattanooga | TN    | 37421 |
| 110 Somerville Ave.        | Chattanooga | TN    | 37405 |
| 313 Stringer St.           | Chattanooga | TN    | 37405 |
| 6823 Bacon Ln.             | Chattanooga | TN    | 37421 |

This document will outline the City's PS and CSOTF maintenance procedures and will be used to train staff in implementing the program. This document will also be used to educate the public on the City's PS Management Program.

## 1.2 Background

The City developed numerous procedures related to PS maintenance, but these were not collated into a single document nor did the procedures address equipment at PSs, CSOTFs, or grinder PSs. This document updates these existing documents while providing maintenance procedures for PSs and CSOTFs. It also provides additional guidance based upon the requirements of the CD and the EPA Region 4 Guide to Collection and Transmission System

Management, Operation, and Maintenance Programs, as set forth in paragraph 20(a) and Appendix B of the CD.

## 1.3 Re-Evaluation of Existing PS and CSOTF Preventive Maintenance

Based on a re-evaluation of the City's existing PS and CSOTF maintenance procedures, the program was found to be sufficient. However, improvements were identified, and these are discussed in detail in Section 5.

#### 1.4 Goals

The goal of this PS Preventive Maintenance Program include: 1) making sure that appropriate staff are aware of the proper maintenance necessary for critical assets at each PS and CSOTF; and 2) making adjustments, as necessary, to the program to reduce SSOs.

## 1.5 Authority

The City's legal authority for the development and implementation of this PS Preventive Maintenance Program is derived from the following federal, state and local laws, ordinances, and regulations:

- The Clean Water Act;
- National Pollution Discharge Elimination System (NPDES) Permit Number TN0024210;
- Tennessee Water Quality Control Act;
- City of Chattanooga Sewer Use Ordinance, City Code Chapter 31; and
- Paragraph 20 (c) of the CD (pages 28-29).

## 1.6 Description of the Wastewater Collection and Transmission System

As a regional wastewater utility, the City of Chattanooga, a Municipal Corporation, owns, operates, maintains, and manages a network of pipes, manholes, pump stations, force mains, CSOTFs, and associated appurtenances that transport wastewater from homes, businesses, and industries to the Moccasin Bend Wastewater Treatment Plant (WWTP). All of this infrastructure is part of the Wastewater Collection and Transmission System (WCTS), as defined in the CD and herein, and managed by the Waste Resources Division (WRD). The City has historically classified the WRD, WWTP and the WCTS as part of the Interceptor Sewer System (ISS). With the advent of the CD and recent reorganizations within the City, the term ISS is not recognized by all stakeholders and therefore the City will refer to WCTS and WWTP as the infrastructure and WRD as the organization to manage this infrastructure going forward. Property owners own the private service laterals from the served residential, commercial, and industrial structures to the public main line in the street or right-of-way, including the connection.

The City's WCTS currently serves approximately 170,000 people with approximately 61,000 customers within the City including 80 permitted industries. It also provides treatment for eight (8) regional or satellite users comprised of approximately 25,000 customers. The WCTS is composed of:

- 1,263 miles of gravity sewers (approximate), including 70 miles of combined sewers;
- 30,000 manholes (approximate);
- 70 PSs;
- 53 miles of force main;
- Eight (8) CSOTFs;
- One (1) Combined Sewer Storage Facility;
- 192 (approximate) residential/grinder pumps; and
- One (1) Moccasin Bend WWTP

An organizational chart for the Waste Resources Division is provided in Appendix H.

## 2.0 Program Documentation

PSs and CSOTFs are operated by the City and a site location list can be found in Section 1 of this document. The City maintains documentation of PS and CSTOF preventive maintenance along with their functionality. Information available in digital and hard copy format to PS and CSOTF maintenance personnel includes the following:

- PS capacity;
- Number of pumps;
- Type of pumps;
- Pump control information;
- Lead/lag/standby pump level settings for wet wells;
- Wet well size/volumes;
- Alarm capabilities;
- Overflow locations and receiving water bodies;
- Safety and other ancillary equipment;
- Flow meter information;
- · Map and driving directions to PS; and
- Photographs of the PS/CSOTF.

Most of this information is included in the PS Inventory book located in the Maintenance Management Center in the basement of the Operations and Control building at the WWTP. Additional information can be found in the PS operations and maintenance (O&M) manuals located in the Plant Maintenance Building as well. Maintenance of the PS and CSOTF is performed by utilizing Preventive Maintenance (PM) work orders and Corrective Maintenance (CM) work orders generated from the City's Computerized Maintenance Management System (CMMS) CityWorks™. PM work orders include tasks for maintenance and operations staff as well as predictive maintenance tasks such as vibration and infrared monitoring performed by contractors. CM work orders are generated as a result of PM work orders or at the request of operations or maintenance staff to address maintenance and repair issues.

Documentation for the PM Program includes an inspection report for electrical, mechanical, and physical PM inspections (found in the appendices), work orders for repairs as outlined in Section 3.3, "Reactive Component" found in this document, and a weekly list of outstanding repairs.

Once a PM work order has been generated by CityWorks, a checklist is used for operational checks at that PS. A CM is generated for any problems discovered. Operators note in a logbook any corrective action that was performed, and maintenance work is kept as machine history in CityWorks. The following sections of this PS Preventative Maintenance Program describe in further detail preventive maintenance for PSs and CSOTFs, including electrical, mechanical,

and physical components that are outside of and in addition to the actions described in the PS and CSOTF Operations Program.

## 3.0 Description of Program

This PS and CSOTF Maintenance Program includes the following components:

- Electrical maintenance;
- Mechanical maintenance;
- · Physical maintenance; and
- PS and CSOTF reactive component.

The electrical, mechanical, and physical maintenance components provide guidance to managers and field personnel responsible for the appropriate preventive maintenance on PSs and CSOTFs.

The PS and CSOTF reactive component serves as a reactive maintenance system to repair PSs and CSOTFs that are currently in need of repair but are still cost-effective to service. This component establishes a method of identification, prioritization, scheduling, and repair of PSs or CSOTFs on a timely basis once a PS or CSOTF critical PS component has deteriorated beyond the scope of the PM programs. This component includes the following:

- A process for identifying a prioritized inventory of PSs and CSOTFs in need of repair;
- A process for documenting an ongoing inventory of completed repairs; and
- A target timeframe for repairs.

CityWorks is utilized to prioritize and keep track of maintenance activities. O&M personnel request that a CM be created by the Asset Manager or the Maintenance Planner, who creates the work order in CityWorks. PMs have a regular schedule frequency and are issued automatically. CM work orders are given a priority code by the CM creator, which determines the schedule for completion. PM work orders generally have an attached maintenance template(s) which describes the maintenance task(s) and the materials and tools required, necessary labor types (operator, mechanic, electrician, etc.) and estimated labor effort. The maintenance templates are standardized documents where it makes sense to develop consistency in maintenance procedures.

When the PM or CM is completed, the staff completing the work fills out data on the PM including a listing of materials used, the actual amount of time it took to complete the work, any notes or comments concerning future maintenance needs, and any improvements to the maintenance procedures. This information is reviewed by the maintenance manager, who signs off that the work order is complete. This work order is then returned to the work management center, which enters the pertinent notes into the CMMS, thereby improving the process and developing machine (equipment) history.

Workflow charts have been developed depicting the work order process including a high level overview, the process of creating work orders, and the process of responding to and completing work orders. These workflow charts are included in Appendix A.

#### 3.1 Preventive Maintenance Schedule

The following are examples of equipment types, which are scheduled for regular PM through CityWorks-generated work orders:

- Pumps;
- Motors:
- Flow Meters;
- Valves:
- Bar Screens:
- Air Filters:
- Slide/Sluice Gates;
- Actuators:
- High Level Floats;
- Bubbler tubes:
- PLC Cabinets;
- Switchgear;
- MCCs;
- Control Panels;
- Instrumentation (pressure transmitters, level switches, etc.);
- VFDs; and
- HVAC Equipment.

The maintenance performed on this equipment by maintenance staff may be suggested by the specific manufacturer in the vendor's O&M manual or developed through operational experience and includes preventive, as well as predictive maintenance activities. Predictive maintenance tasks include thermography of electrical and some mechanical equipment, vibration monitoring of the larger pumps, and some limited oil sampling and analysis. PS Operations staff also perform some "light" PM. Operator-performed maintenance includes exercising and inspecting valves, float checks, draw-down testing and flow meter history review.

PM work orders are generated by maintenance staff and describe in detail regular maintenance required for critical equipment. Frequencies are monthly, quarterly, semi-annually, or every 18 months as required. CM work orders are requested by PS Operators when necessary based on the results of routine and emergency operations or by maintenance personnel as a result of performing PMs. Additional information can be found in Section 2 of the PS and CSOTF Operations Program document. A method for prioritizing a CM is included in the PS Preventative Maintenance Program, Section 3.3 - Reactive Component.

Schedules for maintenance have been adapted at times to the specific conditions or specific equipment at the PSs. This information is contained in CityWorks and used to issue the PM work orders.

#### 3.1.1 Electrical Preventive Maintenance

The electrical component of the PS Preventative Maintenance Program provides guidance to managers and field personnel responsible for electrical maintenance so that preventive

maintenance on PS and CSOTF electrical components are performed on a routine basis. This component includes meter calibration schedules (by meter type) for meters used to record data collected at or from a PS or CSOTF as well as maintenance on power and control systems. Electrical maintenance is primarily performed by electricians and instrumentation technicians.

#### 3.1.1.1 Checklist

A checklist of typical baseline electrical PMs for PSs and instruments, such as level indicators, safety devices, and temperature switches is found in Appendix B of this document. Equipment in each PS within the City's WCTS has its own schedule for PM, which has been programmed into CityWorks.

#### 3.1.1.2 Meter Calibration

There are two functional types of flow meters associated with the PSs. Some are used for operational control and monitoring the PS and the equipment and some are also used for billing purposes. Meters used for billing are generally calibrated quarterly. Other flow meters are calibrated annually. City staff calibrate all of the meters. This is described on the PM work orders. A complete list of flow meters with the required calibration frequency is included in Table 3.1:

**Table 3-1.** Flow Meter List

| PS                      | Calibration Frequency |
|-------------------------|-----------------------|
| 19th Street CSOTF       | Annually              |
| 19th Street PS          | Annually              |
| 23rd Street PS          | Annually              |
| 26th Street PS          | Annually              |
| Airport PS #1           | Annually              |
| Airport PS #2           | Annually              |
| Altamont PS             | Annually              |
| Alton Park PS           | Annually              |
| Arbor Creek Lift PS     | Annually              |
| Battery Place Pump PS   | Annually              |
| Big Ridge Pump PS #1    | Annually              |
| Big Ridge Pump PS #2    | Annually              |
| Big Ridge Pump PS #3    | Annually              |
| Big Ridge Pump PS #4    | Annually              |
| Big Ridge Pump PS #5    | Annually              |
| Big Ridge Pump PS #6    | Annually              |
| Big Ridge Pump PS #7    | Annually              |
| Big Ridge Pump PS #8    | Annually              |
| Big Ridge Pump PS #9    | Annually              |
| Big Ridge Pump PS #10   | Annually              |
| Big Ridge Pump PS #11   | Annually              |
| Big Ridge Pump PS #12   | Annually              |
| Big Ridge PS #13        | Annually              |
| Big Ridge PS #14        | Annually              |
| Boyscout Road PS        | Annually              |
| Brainerd Golf Course PS | Annually              |
| Brainerd Manor PS       | Annually              |

**Table 3-1.** Flow Meter List

| PS                               | Calibration Frequency |
|----------------------------------|-----------------------|
| Carter Street CSOTF              | Annually              |
| Central Avenue CSOTF             | Annually              |
| Citico CSOTF                     | Annually              |
| Citico PS #2                     | Annually              |
| Collegedale PS                   | Quarterly             |
| Davidson Place                   | Annually              |
| Dupont Industrial Park           | Annually              |
| Dupont Parkway PS                | Annually              |
| East Brainerd PS                 | Annually              |
| Eastgate PS #1                   | Annually              |
| Eastgate PS #2                   | Annually              |
| Enterprise South Industrial Park | Annually              |
| Fagan Street PS                  | Annually              |
| Friar Branch PS                  | Annually              |
| Heritage Green PS                | Annually              |
| Highland Park PS                 | Annually              |
| Hixson PS #1                     | Annually              |
| Hixson PS #2                     | Annually              |
| Hixson PS #3                     | Annually              |
| Komatsu PS                       | Annually              |
| Lake Vista PS                    | Annually              |
| Latta Street PS                  | Annually              |
| Manker Patten PS                 | Annually              |
| Meadow Trace PS                  |                       |
| MLK CSOTF                        | Annually              |
| Mt Creek                         | Annually              |
|                                  | Annually              |
| Murray Hills #1                  | Annually              |
| Murray Hills #2                  | Annually              |
| Murray Hills #3                  | Annually              |
| Murray Hills #4                  | Annually              |
| Murray Hills #5                  | Annually              |
| Orchard Knob PS                  | Annually              |
| Pineville PS                     | Annually              |
| Ringgold PS                      | Quarterly             |
| River Park #1                    | Annually              |
| River Park #2                    | Annually              |
| Ross Landing CSOTF               | Annually              |
| South Chickamauga PS             | Annually              |
| Spring Creek PS                  | Quarterly             |
| Summit Landfill PS #1            | Annually              |
| Summit Landfill PS #2            | Annually              |
| Tiftonia PS #1                   | Annually              |
| Tiftonia PS #2                   | Annually              |
| Tiftonia PS #3                   | Annually              |
| Tiftonia PS #4                   | Annually              |
| Tiftonia PS #5                   | Annually              |
| Tremont CSOTF                    | Annually              |
| Vaap Plant                       | Quarterly             |
| Warner Park CSOTF                | Annually              |

**Table 3-1.** Flow Meter List

| PS                    | Calibration Frequency |
|-----------------------|-----------------------|
| West Chickamauga PS   | Quarterly             |
| Williams Street CSOTF | Annually              |

In addition to the above table, the City also reads and calibrates the Dade County PS and Lookout Mountain PS meters quarterly, although these PSs are not owned by the City.

#### 3.1.2 Mechanical Preventive Maintenance

This mechanical component of the PS Preventative Maintenance Program provides guidance to managers and field personnel responsible for mechanical maintenance so that preventive maintenance on PS or CSOTF mechanical components is performed on a routine basis. Mechanical maintenance is primarily performed by mechanics.

#### 3.1.2.1 Checklist

A checklist of typical baseline mechanical PMs for PSs is found in Appendix C. Equipment in each PS within the City's WCTS has its own schedule for PM, which has been programmed into CityWorks.

#### 3.1.3 Physical Preventive Maintenance

This physical maintenance component of the PS Preventative Maintenance Program provides guidance to managers and field personnel responsible for physical maintenance (pipes, walls, inverts, covers, etc.), so that PM on PS or CSOTF physical components is performed on a routine basis. PS inspections are performed on a regular basis by operations staff as described in the PS Operations Program. Through these inspections, issues or deficiencies in the physical assets are noted and CM work orders are created to address these deficiencies. Detailed biannual inspections (once every other year) of the physical condition of the PSs and CSOTFS are to be performed by maintenance staff. Based on the results of the regular operational inspections and the bi-annual detailed inspections, the need for significant physical maintenance will be identified and work to address the issues scheduled through regular maintenance budgets or through capital improvements.

#### 3.1.3.1 Checklist

A checklist of typical baseline physical PM for PSs can be found in Appendix D. Each PS within the City's WCTS has its own schedule for PM, which has been programmed into CityWorks.

### 3.2 Standard Inspection Forms

See Appendices E, F, and G for electrical, mechanical and physical inspection forms, respectively. Inspection forms when completed are returned to the maintenance planner for development of PMs or CMs as required.

### 3.3 Reactive Component

This reactive component of the PS and CSOTF Maintenance Program provides guidelines to repair PSs and CSOTFs that need maintenance but are still cost-effective to service. This component provides for the identification, prioritization, scheduling, and repair of PSs or CSOTFs on a timely basis once a PS or CSOTF or critical PS or CSOTF component has deteriorated beyond the scope of the maintenance program. This component includes the following:

- Guidance outlining when a PS, critical PS component or CSOTF is to be placed in the repair program;
- A process for identifying a prioritized inventory of PSs and CSOTFs in need of repair;
- A process for documenting an ongoing inventory of completed repairs;
- A target timeframe for repairs; and
- Relevant documentation of program implementation.

#### 3.3.1 Guidance for Prioritization

The City maintains its PSs and CSTOFs to provide for the goals identified in Section 1 of this document. If a critical asset associated with a PS is out of service, then the PS falls within the reactive maintenance component. Out of service assets or assets in need of major repair are assigned CM work orders with a priority code. CM work orders are written by the City's Maintenance Planners.

Priority codes are assigned to CM work orders by Maintenance Planners in consultation with O&M Staff. CM work orders are then approved by a maintenance supervisor, if necessary. After a code has met approval, the work order is entered in CityWorks. A list of current work orders for pump stations in need of repair and a list of completed repairs have been added to Appendix I and J, respectively.

#### 3.3.2 Scheduling Guidelines

Repairs are scheduled using work order priority. Work order priorities range from Priority 1 to Priority 3 and are explained below:

- Priority 1: This repair requires immediate attention and is considered to be of the highest priority. This WO could result in overtime and after-hours labor. Work will be continuous until repaired. Overtime is authorized.
- Priority 2: This second priority results in repair typically within a 24 hour to 48 hour repair time and will seldom require overtime, weekend, or after hours work. Priority 2 is considered less of a critical repair than Priority 1.
- Priority 3: This represents every repair that does not fit into Priority 1 or Priority 2. No afterhours work will be required and usually there is no cause for overtime.

Priority selection is a result of work orders being reviewed by appropriate staff. Priorities 1 and 2 are reviewed and approved by maintenance supervisors. Supervisors have discretion to reevaluate priorities according to the following criteria:

- Weather conditions;
- Status of other equipment at PS;
- Staff availability;
- Operational history;
- Site specific conditions; and
- Level of degradation to equipment and PS operation.

#### 3.3.3 Corrective Maintenance Tracking

The following process identifies the method of tracking repairs and maintaining an inventory of completed repairs:

- 1. A need for repair is identified by an operator or maintenance staff.
- 2. A work order with a priority code is drafted by the Maintenance Planner.
- 3. PS Operations decides Priority status and the work order is finalized.
- 4. The work order is entered into CityWorks and added to a list of outstanding repairs.
- 5. Weekly status of repair is updated and equipment which is out of service is noted on chalk board or dry erase board in the O&C Building Control Room.

Grinder PSs are maintained on a reactive basis. Five new grinder pumps are purchased each year and used to replace failing pumps.

## 4.0 Resource Management

The following section of this PS Preventative Maintenance Program describes in detail parties responsible for the implementation of the PM program for the City. Information found within this section will include organizational charts (see Appendix H) showing maintenance personnel including management and those in a supervisory role as well as general qualifications required by all personnel involved in any aspect of maintenance as set forth by the City.

#### 4.1 Personnel

The organization chart for the Maintenance Department can be found in Appendix H (Chart 4). The department is led by the Maintenance Manager, who reports to the Deputy Director. Reporting to the Maintenance Manager are the Maintenance Planner, the Asset Management Systems Coordinator and the Maintenance Chiefs. There is no separate PS or CSTOF maintenance staff - the electricians, mechanics, lubricators and laborers attend to plant and PS and CSOTF PM and CM needs.

During emergencies, the personnel resources of the entire WRD department staff are available to support maintenance staff. In addition, on-call contracts with local contractors are in place to provide additional personnel if needed.

The job description and skill requirements are provided on the City's website at <a href="http://www.chattanooga.gov/2011-12-14-14-38-52/job-descriptions">http://www.chattanooga.gov/2011-12-14-14-38-52/job-descriptions</a>.

#### 4.1.1 Electrical Maintenance Personnel

Duties of personnel responsible for electrical maintenance include, but are not limited to, the following:

- Performing a variety of routine electrical maintenance activities, which may include repairing and installing electrical conduit, relays, switches, fixtures, receptacles, controls, circuits and related items, replacing plugs on electrical equipment, troubleshooting electrical problems, and/or performing other related activities.
- Calibrating gas sensors and flow meters.
- Maintenance of the SCADA system.
- Conducting and completing the PM Electrical Inspection Schedule found in Appendix B of this document.
- Performing other duties as assigned.
- Maintaining records and logs of work performed.
- Minimum qualifications include:
- Vocation/technical training in electrical work and HVAC.
- Ability to operate applicable tools and equipment of the trade.

• Licensure or certification in electrical or other applicable trade.

#### 4.1.2 Mechanical Maintenance Personnel

Duties of personnel responsible for mechanical maintenance include, but are not limited to, the following:

- Monitoring mechanical systems to ensure proper functioning, diagnosing potential problems, troubleshooting, and repairing machinery.
- Diagnosing and repairing PS, motors, sump pumps, valves and gate valves, and performing minor fabrication of parts as required.
- Diagnosing and repairing mechanical machinery at master PSs, including pumps, motors, gear reducers, valves, and bar screen systems.
- Inspecting and repairing cell gates, cell blowers, hydraulic valves, and water lines.
- Maintaining records and logs of work performed.
- Conducting and completing the PM Mechanical Inspection Schedule found in Appendix C of this document.
- Performing other duties as assigned.

Minimum qualifications include:

- High School Diploma or G.E.D.
- Three years mechanical experience in wastewater or water plant setting.
- Valid Tennessee Driver's License.
- Must be able to obtain a Forklift Certification.

#### 4.1.3 Physical Maintenance Personnel

Duties of personnel responsible for physical maintenance are similar to those required for mechanical maintenance and include, but are not limited to, the following:

- Checking and changing oil in machinery and equipment as well as applying grease to minimize noise vibration of machinery and equipment.
- Performing routine preventive maintenance on applicable machinery and equipment to ensure safety and efficiency of operations.
- Checking and replacing belts and parts.
- Cleaning machinery and equipment, including wet wells and bar screens.
- Operating various equipment and machinery to provide basic maintenance to the buildings, grounds and related facilities of the PS and CSOTF.
- Maintaining records and logs of work performed.
- Conducting and completing the PM Physical Inspection Schedule found in Appendix C of this document.

· Performing other duties assigned.

Minimum Qualifications include:

- High School Diploma or G.E.D.
- One year of machinery and equipment experience
- A valid Tennessee Driver's License
- Ability to obtain Forklift Certification

#### 4.2 SCADA Maintenance

Maintenance for the City's SCADA system for PSs and CSOTFs is performed utilizing PM work orders and CM work orders generated by CityWorks. Specific SCADA-related maintenance items can be found in the Electrical Inspection as well as the Electrical Inspection Report (Appendix E).

### 5.0 Performance Measures

As part of the proactive Equipment Maintenance and Reliability Improvement Program (EMRIP), the City has established performance measures or key performance indicators (KPIs) related to maintenance and work order management for PSs and CSOTFs. Tracking KPIs allows the City to measure the status of their maintenance program and to make adjustments if required. The following KPIs are directly related to the performance of the PS and CSOTF Maintenance Program and will be monitored by the Maintenance Manager when fully implemented:

**Table 5-1**KPIs for PSs and CSOTFs

| KPI   | Purpose   | Target   | Responsibility            | Frequency                                 |
|---|---|--|---------------------------|---|
| Work Backlog  | Measure progress  | Not more than 6<br>weeks of work                                     | Craft Chief               | Weekly reviews with daily updates         |
| Work Orders<br>Awaiting Parts                       | Track the number of work orders incomplete due to materials and parts | No work order older<br>than 30 days<br>awaiting parts                | Stores Manager            | Weekly reviews with daily updates         |
| Actual labor<br>availability                        | Develop a work<br>schedule based upon<br>actual labor<br>availability | Develop a daily<br>schedule based on<br>actual labor<br>availability | Craft Chief               | Weekly reviews with daily updates         |
| PM Completion<br>Schedule                           | Assure all PMs are being completed as scheduled                       | 95% adherence to PM schedule   | Craft Chief               | Weekly reviews with daily updates         |
| Overtime as a<br>Percent of Total<br>Hours Worked   | Evaluate the use and cost of labor                                    | Less than 5%   | Maintenance<br>Supervisor | Weekly reviews with monthly updates       |
| Number of<br>Preventable Work<br>Orders             | Limit and track work orders that could have been preventable          | Less than 5<br>preventable work<br>orders per month                  | Maintenance<br>Supervisor | Weekly reviews<br>with monthly<br>updates |
| Track Work Orders<br>by Failure Code                | Evaluate work by the types of failures experienced                    | 15 Categories of failure codes                                       | Planner or Craft<br>Chief | Daily with weekly updates                 |
| Track the Work<br>Orders Found Via<br>PM Activities | Evaluate the success of the PM program                                | Less than 6 PM cycles per work order generated                       | Craft Chiefs              | Daily with weekly updates                 |
| Track the Age of<br>Work Orders                     | Not let the work orders get lost in the process                       | No work orders older than 6 months                                   | Maintenance<br>Supervisor | Weekly reviews with monthly updates       |
| Percentage of<br>Emergency Work<br>Orders           | Track the reliability of the City assets                              | Less than 10% of<br>the work orders are<br>emergencies               | Craft Chiefs              | Daily with weekly updates                 |

### 6.0 Periodic Evaluation/Continuous Improvement

### 6.1 Periodic Evaluation

The City checks the PS Operations Program KPIs on a monthly basis with a more comprehensive self-evaluation done on an annual basis. The self-evaluation is performed with consideration to the EPA guideline: Guide for Evaluating CMOM Programs at Sanitary Sewer Collection Systems.

### 6.2 Continuous Improvement Initiatives

The following initiatives are being implemented by the City in order to improve the PS and CSOTF Maintenance Program:

- The City performs a periodic evaluation of the Maintenance Program by review of PS and CSOTF-related KPIs on a monthly basis with a more comprehensive self-evaluation done on an annual basis.
- Continuous improvement of the Maintenance Program is achieved by the tasks listed in subsections 6.2.1 through 6.2.4.

#### 6.2.1 Checklist Enhancements and Use

This initiative includes review and revision of inspection checklists and reports, and regular use of the checklists. This review will be performed annually.

- Target Timeframe: Determine whether PSs have been visited and checklists and inspection reports completed for PSs and CSOTFs by December 2016.
- Review and update checklists and reports by June 2017.
- Responsible Party: Maintenance Manager and Deputy Director.

### 6.2.2 Fully Implement and Monitor KPIs

KPIs have been developed to track maintenance effectiveness but the required data to input into the KPIs is not always gathered. This initiative includes determining whether data required to input into the KPIs is collected and KPIs are monitored daily, weekly, or monthly as required.

- Target Timeframe: Determine whether data is collected and KPIs monitored June 2016
- Responsible Party: Maintenance Manager and Deputy Director

### 6.2.3 Develop a Program to Locate and Maintain Air Relief Valves

There are many air relief valves associated with wastewater force mains throughout the WCTS. Some of these are easy to locate and maintain while others are more difficult. This initiative consists of identifying and locating air relief valves in the system, visiting them to evaluate

existing conditions and developing access routes, and then developing a maintenance program for these valves.

- Target Timeframe: June 2018
- Responsible Party: Maintenance Manager and Deputy Director

#### 6.2.4 Continue the Development and Refinement of PM Work Orders

PMs have been developed for the majority of the critical equipment at the PSs and CSOTFs. There are additional PMs which could be considered, including an enhanced use of predictive maintenance tasks. In addition, as PMs are completed and repeated, modifications or refinements of the work order tasks become apparent to improve efficiency and minimize equipment downtime. These may include refining the hour estimates, creating material lists, or other improvements. The task of developing and refining work orders is truly continuous.

- Target Timeframe: None –a continuous process
- Responsible Party: Maintenance Manager, Maintenance Planner, and Deputy Director


#### 6.2.5 Capacity Management Operations and Maintenance (CMOM) Development


As part of the initial CMOM Development, the City completed the following initiatives:


- **Development of PMs for critical equipment**. As part of the initial CMOM development, the City developed PM work orders for more than a thousand critical assets.
- Development of a method to track performance. As part of the initial CMOM development, the City developed PS maintenance KPIs.
- Development of weekly operational checks for critical PSs. As part of the initial CMOM development, the City developed Inspection Checklists and Report templates for use in regular electrical, mechanical and physical maintenance as described in Section 2 and Section 3 of this document.

## Appendix A Work Order Flow Charts

### High Level Work Order Request Procedure for Liquids, Solids, and Pump Stations Maintenance

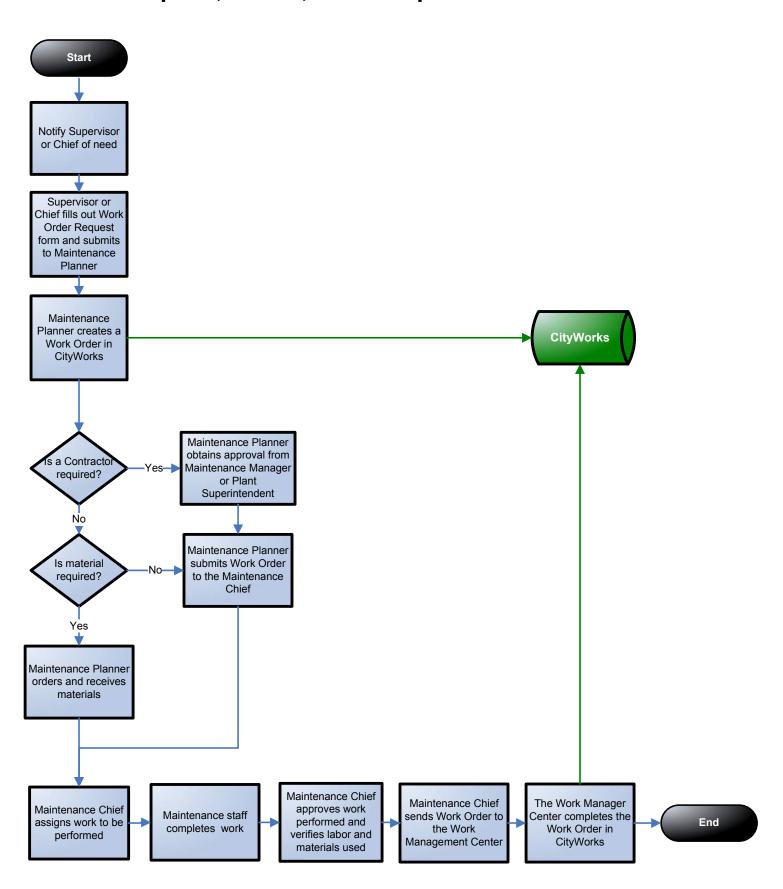

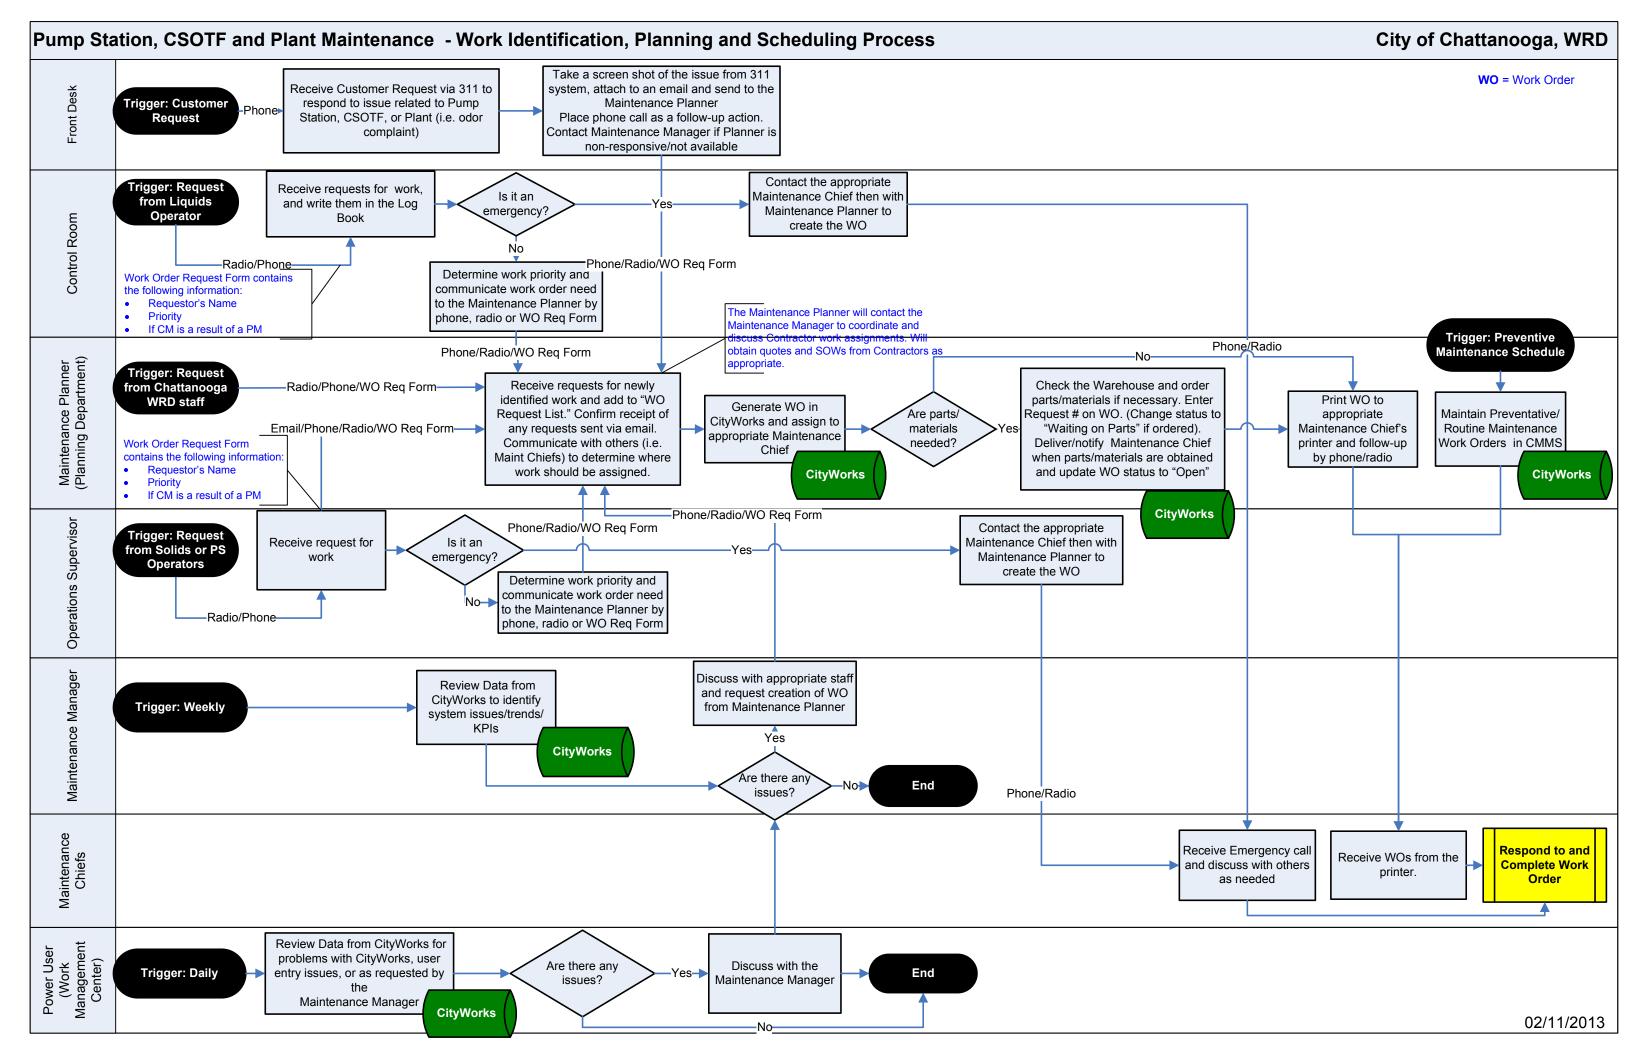

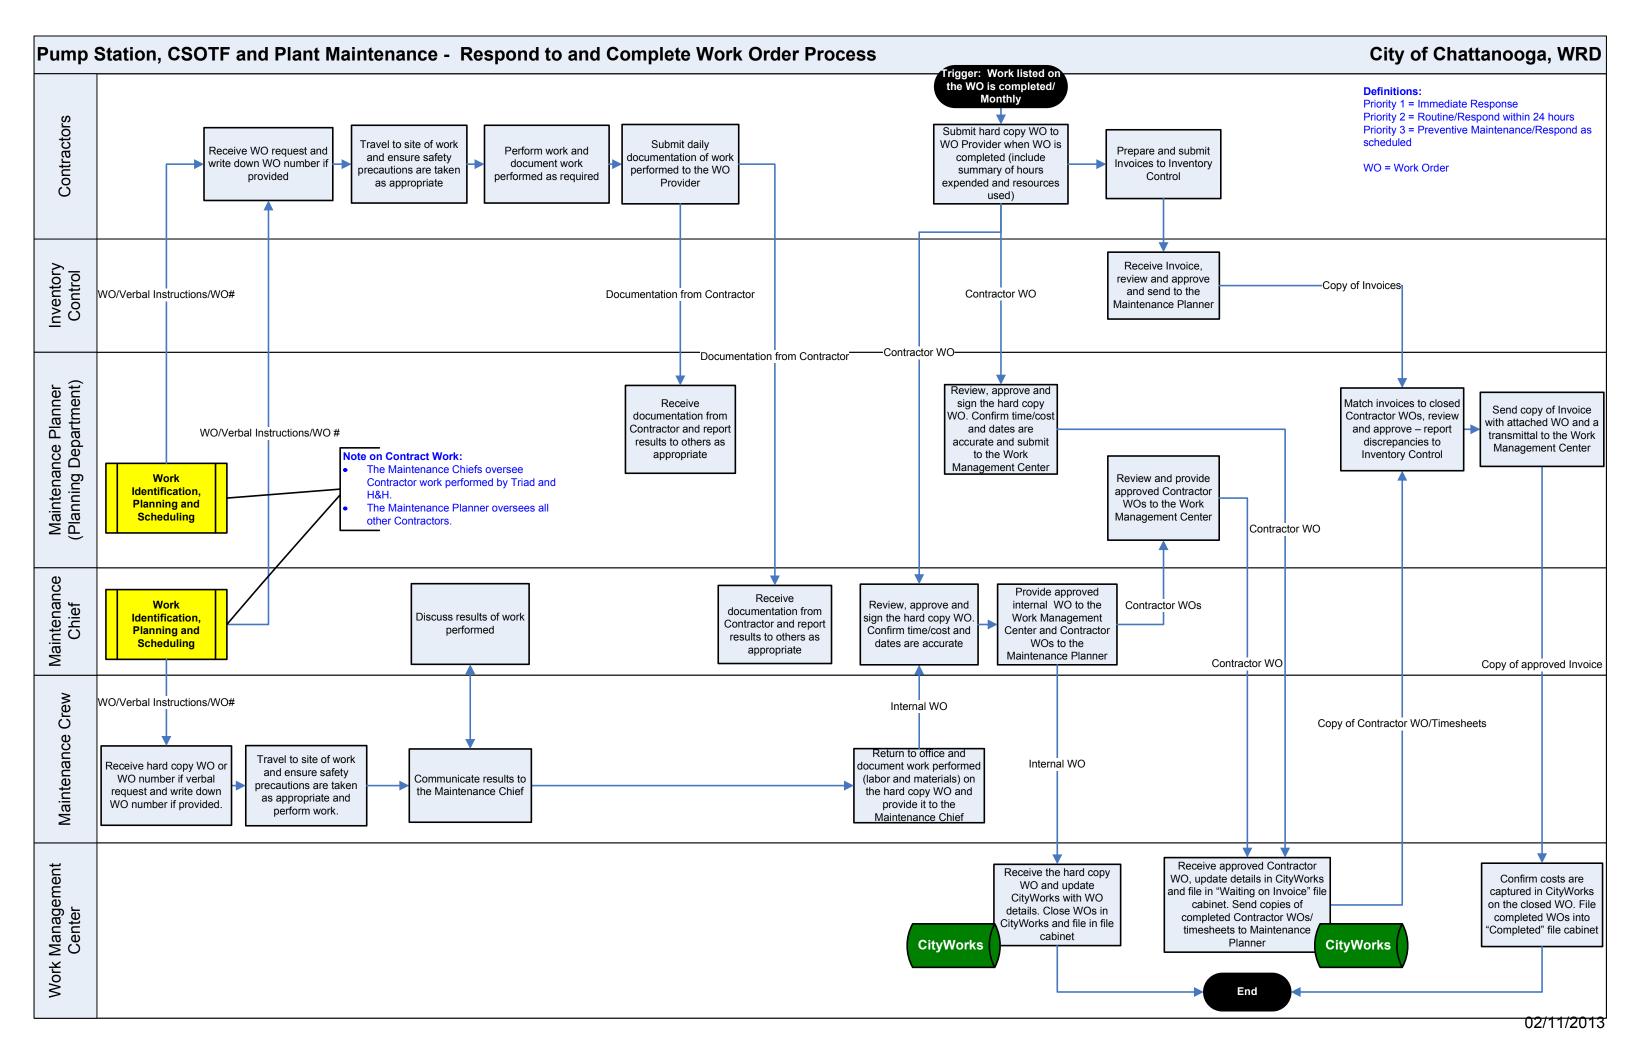

# Appendix B Example of PS Electrical Inspection and Preventive Maintenance Checklist

| PS Electrical Inspection and Preventive Maintenance Checklist                |         |                 |        |                    |  |
|--|---------|-----------------|--------|--------------------|--|
| Item   | Monthly | Semi-<br>Annual | Annual | Every 18<br>Months |  |
| Conduct CSO overflow simulation  | X       |                 |        |                    |  |
| Conduct regulator overflow simulation  | X       |                 |        |                    |  |
| Calibrate LEL meter at CSO   | X       |                 |        |                    |  |
| Check telemetry and replace battery  |         |                 |        | Х                  |  |
| Inspect and clean the MCC components for loose connections, dirt, and debris |         |                 |        | Х                  |  |
| Inspect bus and buckets for loose connections and signs of overheating       |         |                 |        | Χ                  |  |
| Clean and visually inspect bar screen motor                                  |         |                 | X      |                    |  |
| Clean and visually inspect pump motors                                       |         |                 | X      |                    |  |
| Clean and visually inspect Switchgear  |         |                 | X      |                    |  |
| Inspect electrical connections on PLC  |         |                 | X      |                    |  |
| Perform electrical check of motorized actuators                              |         |                 | X      |                    |  |
| Perform electrical check on belt drive fans                                  |         |                 | X      |                    |  |
| Perform insulation resistance test on switchgear                             |         |                 | X      |                    |  |
| Perform visual inspection on flow meter.                                     |         | Х               |        |                    |  |
| Inspect and clean PLC cabinet  |         | Х               |        |                    |  |
| Perform airborne ultra-sound on Switchgear                                   |         | Х               |        |                    |  |
| Perform motor current analysis (offline) on pump motors                      |         | Х               |        |                    |  |
| Clean, perform visual inspection and thermography of VFD.                    |         |                 | X      |                    |  |

### Appendix C Example of PS Mechanical Inspection and Preventive Maintenance Checklist

| PS Mechanical Inspection and Preventive Maintenance Checklist                 |         |           |                 |        |
|---|---------|-----------|-----------------|--------|
| Item  | Monthly | Quarterly | Semi-<br>Annual | Annual |
| Clean and visually inspect belt drive fan                                     |         |           |                 | X      |
| Lubricate bar screen motor  |         |           |                 | X      |
| Lubricate couplings on pumps  |         |           |                 | X      |
| Lubricate direct drive fan  |         |           |                 | X      |
| Lubricate pump motors   |         |           |                 | X      |
| Perform visual inspection of direct drive fan                                 |         |           |                 | X      |
| Clean, visually inspect and adjust slide gates                                |         |           |                 | X      |
| Collect carbon sample from tub scrubber for analysis                          |         |           |                 | X      |
| Perform operational check and visual inspection of gate valves >12", but <30" |         |           |                 | X      |
| Perform operational test and visual inspection on slide gates                 |         |           |                 | X      |
| Lubricate direct drive fan on tub scrubber                                    |         |           |                 | X      |
| Perform visual inspection of direct drive fan on tub scrubber                 |         |           |                 | X      |
| Change gear box oil   |         |           | Χ               |        |
| Lubricate mechanical bar screen   | X       |           |                 |        |
| Inspect mechanical bar screens  | X       |           |                 |        |
| Lubricate bearings on pumps   |         | X         |                 |        |
| Replace air filters and check condition of belts                              |         | X         |                 |        |
| Lubricate motorized actuators   |         |           | Х               |        |
| Lubricate slide gates   |         |           | Х               |        |
| Lubricate sluice gates  |         |           | Х               |        |
| Conduct sampler inspection at CSO   | X       |           |                 |        |
| Perform visual inspection and operational check of high level floats          |         |           |                 | X      |

# Appendix D Example of PS Physical Inspection and Preventive Maintenance Checklist

| PS P                         | hysical I | nspection | and Preve | entive Mainte | enance Checklist                             |        |           |
|------------------------------|-----------|-----------|-----------|---------------|--|--------|-----------|
| Item                         | Daily     | Weekly    | Monthly   | Quarterly     | Semi-Annually                                | Annual | Other     |
| Exterior                     |           |           |           |               |  |        |           |
| General Appearance           |           |           |           |               |  |        | As Needed |
| Grass/Shrubs                 |           |           |           |               |  |        | As Needed |
| Walks/Drives                 |           |           |           |               |  | X      |           |
| Doors/Windows/Trim           |           |           |           |               |  | X      |           |
| Fence/Gates/Driveway Barrier |           |           |           |               |  | X      |           |
| Walls                        |           |           |           |               |  | X      |           |
| Gutters/Downspouts           |           |           |           |               |  | Χ      |           |
| Roofing/Vents/Chimney        |           |           |           |               | 1  | Χ      |           |
| Steps/Rails/Hatches          |           |           | X         |               |  | Χ      |           |
| Louvers/Screens/Grills       |           |           |           |               |  | Χ      |           |
| Emergency. Signs/Address No. |           |           |           |               |  | Χ      |           |
| Vaults/Chambers              |           |           |           |               | X  |        |           |
| Manhole Covers/Valve Boxes   |           |           |           |               | X  |        |           |
| Paint Code Observed          |           |           |           |               |  |        | As Needed |
| Interior                     |           |           |           |               |  |        |           |
| General Appearance           |           |           |           |               |  |        | As Needed |
| Walls/Ceilings/Floors        |           |           |           |               |  | Χ      |           |
| Steps/Rails/Hatches          |           |           |           |               |  | Χ      |           |
| Ventilation Ductwork         |           |           |           |               |  | X      |           |
| Doors/Windows/Trim           |           |           |           |               |  | X      |           |
| Wet wells                    |           |           |           |               |  | X      |           |
| Wet well Piping              |           |           |           |               |  | Χ      |           |
| Other                        |           | =         |           |               | <u>.                                    </u> | =      | =<br>     |

## Appendix E Example of PS Electrical Inspection Report

| Date:  | Comments:                               |       |              |                    |                     |
|--|---|-------|--------------|--------------------|---------------------|
| Time:  |   |       |              |                    |                     |
| PS:  | -                                       |       |              |                    |                     |
| Employee:  | •                                       |       |              |                    |                     |
| Weather:   |   |       |              |                    |                     |
|  | PS Electric                             | al In | spection Rep | oort               |                     |
|  |   |       |              | Results/Con        | dition              |
| Item   | Ol                                      | K     | Repaired     | Needs<br>Repairing | Additional Comments |
| Calibrate LEL meter at CSO   | *************************************** |       |              |                    |                     |
| Conduct CSO overflow simulation  |   |       |              |                    |                     |
| Conduct regulator overflow simulation                                    |   |       |              |                    |                     |
| Check telemetry and replace battery                                      |   |       |              |                    |                     |
| Inspect and clean the MCC componer loose connections, dirt and debris    | nts for                                 |       |              |                    |                     |
| Inspect bus and buckets for loose con and signs of overheating           | nections                                |       |              |                    |                     |
| Clean and visually inspect bar screen (See attached procedure)           | motor                                   |       |              |                    |                     |
| Clean and visually inspect pump moto                                     | rs                                      |       |              |                    |                     |
| Clean and visually inspect Switchgear                                    |   |       |              |                    |                     |
| Inspect electrical connections to PLC                                    |   |       |              |                    |                     |
| Perform electrical check of motorized actuators (See attached procedure) |   |       |              |                    |                     |
| Perform electrical check on belt drive                                   | ans                                     |       |              |                    |                     |
| Perform insulation resistance test on Switchgear                         |   |       |              |                    |                     |
| Perform visual inspection and certifica                                  | tion                                    |       |              |                    |                     |
| Inspect and clean PLC cabinet  |   |       |              |                    |                     |
| Perform airborne ultra-sound on Switch                                   | hgear                                   |       |              |                    |                     |
| Perform motor current analysis (offline pump motors                      | e) on                                   |       |              |                    |                     |
| Perform motor current analysis (online pump motors                       |   |       |              |                    |                     |
| Perform motor current analysis (online pump motors                       | e) on                                   |       |              |                    |                     |
| Clean, perform visual inspection and thermography of VFD                 |   |       |              |                    |                     |

# Appendix F Example of PS Mechanical Inspection Report


| Date:  | Comments: |                 |                    |                     |
|--|-----------|-----------------|--------------------|---------------------|
| Time:  |           |                 |                    |                     |
| PS:  |           |                 |                    |                     |
| Employee:  |           |                 |                    |                     |
| Weather:   |           |                 |                    |                     |
|  | PS Mechan | ical Inspection | Report             |                     |
|  |           |                 | Results/Conditi    | on                  |
| ltem   | OK        | Repaired        | Needs<br>Repairing | Additional Comments |
| Clean and visually inspect belt drive fan                                    |           |                 |                    |                     |
| Lubricate bar screen motor   |           |                 |                    |                     |
| Lubricate couplings on pumps   |           |                 |                    |                     |
| Lubricate direct drive fan   |           |                 |                    |                     |
| Lubricate pump motors  |           |                 |                    |                     |
| Perform visual inspection of direct drive fan                                |           |                 |                    |                     |
| Clean, visually inspect and adjust slide gates                               |           |                 |                    |                     |
| Collect carbon sample from tub scrubber for analysis                         |           |                 |                    |                     |
| Perform operational check and visual inspection of gate valves >12" but <30" |           |                 |                    |                     |
| Lubricate direct drive fan on tub scrubber                                   |           |                 |                    |                     |
| Perform visual inspection of direct drive fan on tub scrubber                |           |                 |                    |                     |
| Change gear box oil  |           |                 |                    |                     |
| Lubricate mechanical bar screen  |           |                 |                    |                     |
| Inspect mechanical bar screen  |           |                 |                    |                     |
| Lubricate bearings on pumps  |           |                 |                    |                     |
| Replace air filter and check belts   |           |                 |                    |                     |
| Lubricate motorized actuators  |           |                 |                    |                     |
| Lubricate slide gates  |           |                 |                    |                     |
| Lubricate sluice gates   |           |                 |                    |                     |
| Conduct sample inspection at CSC   |           |                 |                    |                     |
| Perform visual inspection and operational check of high level floats         |           | -               |                    |                     |

### Appendix G Example of PS Physical Inspection Report


| Date:                        | Commer  | nts:              |                    |                     |
|------------------------------|---------|-------------------|--------------------|---------------------|
| Time:                        | -       |                   |                    |                     |
| PS:                          |         |                   |                    |                     |
|                              |         |                   |                    |                     |
| Employee:                    |         |                   |                    |                     |
| Weather:                     |         |                   |                    |                     |
|                              | PS Phys | ical Inspection R | Report             |                     |
| Mana                         |         |                   | Results/Condition  | on                  |
| ltem                         | ок      | Repaired          | Needs<br>Repairing | Additional Comments |
| Exterior                     |         |                   |                    |                     |
| General Appearance           |         |                   |                    |                     |
| Grass/Shrubs                 |         |                   |                    |                     |
| Walks/Drives                 |         |                   |                    |                     |
| Doors/Windows/Trim           |         |                   |                    |                     |
| Fence/Gates/Driveway Barrier |         |                   |                    |                     |
| Walls                        |         |                   |                    |                     |
| Gutters/Downspouts           |         |                   |                    |                     |
| Roofing/Vents/Chimney        |         |                   |                    |                     |
| Steps/Rails/Hatches          |         |                   |                    |                     |
| Louvers/Screens/Grills       |         |                   |                    |                     |
| Emergency. Signs/Address No. |         |                   |                    |                     |
| Vaults/Chambers              |         |                   |                    |                     |
| Manhole Covers/Valve Boxes   |         |                   |                    |                     |
| Paint Code Observed          |         |                   |                    |                     |
| Interior                     |         |                   |                    |                     |
| General Appearance           |         |                   |                    |                     |
| Walls/Ceilings/Floors        |         |                   |                    |                     |
| Steps/Rails/Hatches          |         |                   |                    |                     |
| Ventilation Ductwork         |         |                   |                    |                     |
| Doors/Windows/Trim           |         |                   |                    |                     |
| Wet wells                    |         |                   |                    |                     |
| Wet well Piping              |         |                   |                    |                     |
| Other                        |         |                   |                    |                     |

# Appendix H Waste Resources Division Organizational Chart

### WASTE RESOURCES DIVISION ORGANIZATIONAL CHART

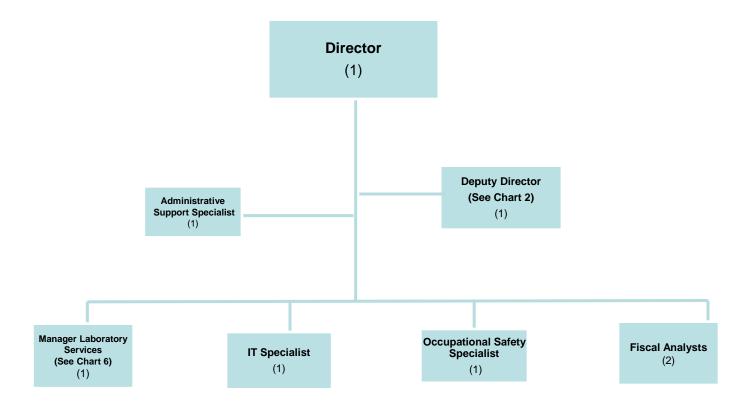


# WASTE RESOURCES DIVISION ORGANIZATIONAL CHART Chart 2 (September, 2014)

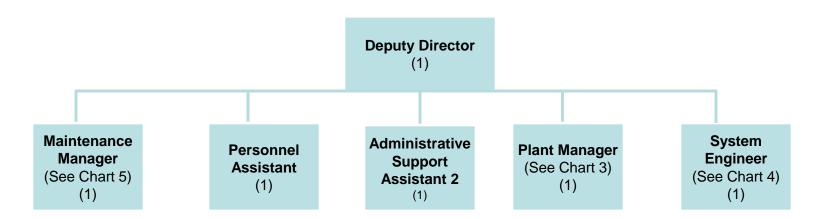


### WASTE RESOURCES DIVISION ORGANIZATIONAL CHART

Chart 3

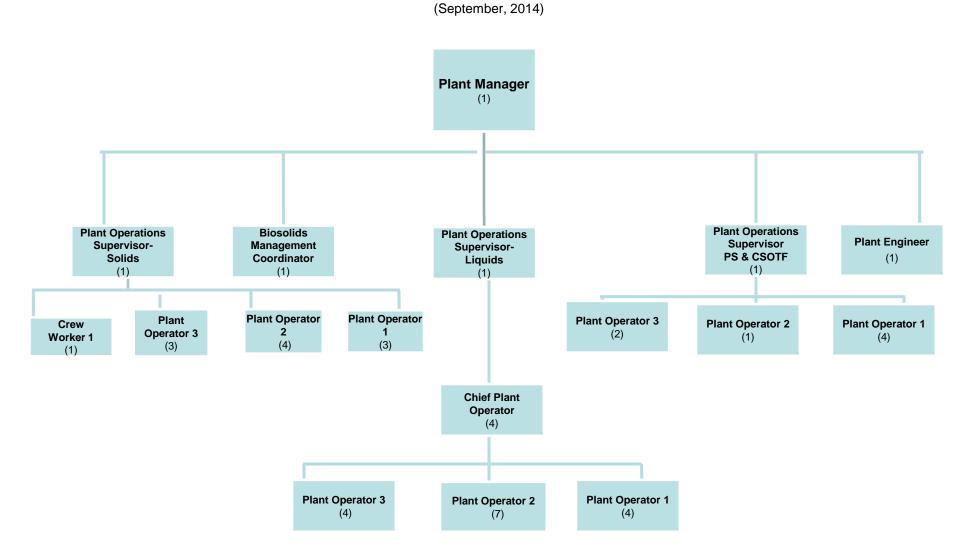


## WASTE RESOURCES DIVISION ORGANIZATIONAL CHART


Chart 4

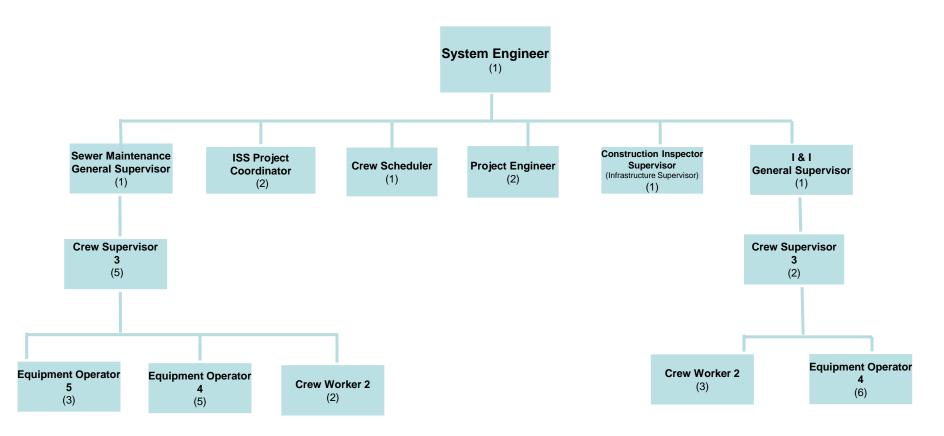

# WASTE RESOURCES DIVISION ORGANIZATIONAL CHART Chart 5

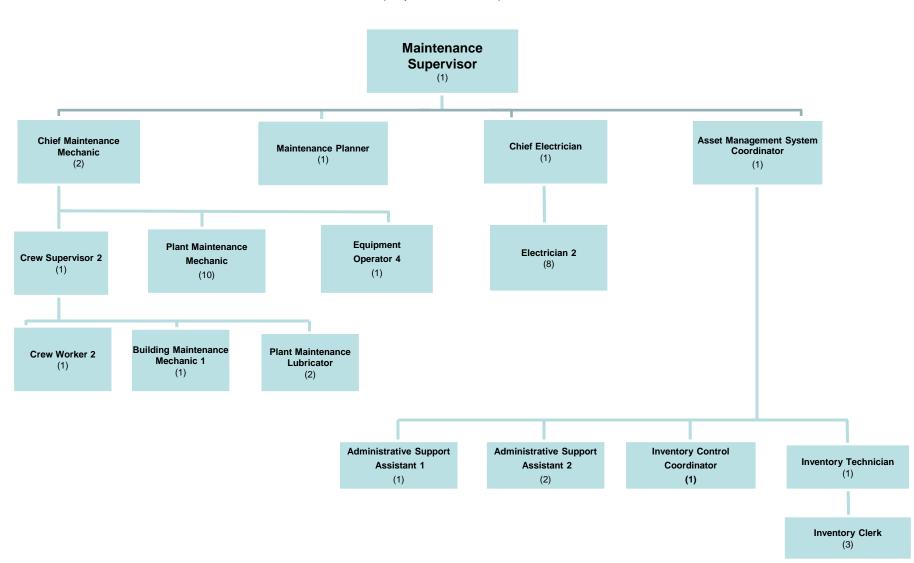

# WASTE RESOURCES DIVISION ORGANIZATIONAL CHART Chart 6

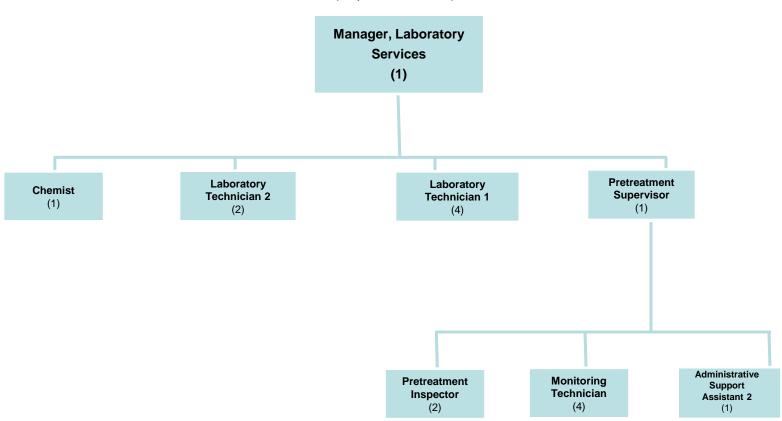

# Appendix I Current PS and CSOTF Work Orders

| ID     | Priority | Location                          | Initiated | Instructions   |
|--------|----------|-----------------------------------|-----------|--|
| 132662 | 1        | TIFTONIA PUMP STATION #5          | 5/20/14   | pump inop / Copy to mechanics to pull  |
| 136337 | 1        | Hixson Pump Station #2            | 8/11/14   | Ball Valve goes into fail and shuts down pump                                      |
| 142876 | 1        | Warner Park SS #2                 | 1/6/15    | Pump #1 Seal Fail/HT   |
| 143565 | 1        | BIG RIDGE PUMP STATION #2         | 1/20/15   | Generator did not excercise as scheduled   |
| 145560 | 1        | AIRPORT PUMP STATION #1           | 3/9/15    | Won't reset to pressure cell from floats   |
| 146428 | 1        | BOYSCOUT ROAD PUMP STATION        | 3/27/15   | HWW Does come in off Miltronics  |
| 146438 | 1        | 03785 KINGS RD                    | 3/27/15   | Grinder Pump Inop.   |
| 146926 | 1        | Enterprise South Telemetry        | 4/9/15    | Switch from old Telemetry to new Telemetry   |
| 147295 | 1        | NORTH TERRACE STORM WATER STATION | 4/17/15   | Pumps will not run in auto   |
| 147367 | 1        | CITICO PUMP STATION #2            | 4/20/15   | Pump #4 will not run in auto.  |
| 147379 | 1        | SOUTH CHICKAMAUGA PUMP STATION    | 4/20/15   | Pump #3 drive in fail  |
| 147428 | 1        | MT CREEK                          | 4/20/15   | Replace ballast at pump station.   |
| 147495 | 1        | SPRING CREEK PUMP STATION         | 4/21/15   | Meg #2 pump.   |
| 147607 | 1        | Murray Hills #3                   | 4/22/15   | Antenna connection water proofing has failed. Dry out connection, clean and        |
|        |          |                                   |           | inspect, then re-seal.   |
| 147659 | 1        | SOUTH CHICKAMAUGA PUMP STATION    | 4/23/15   | Replace refrigeration tubing, insulation   |
| 147718 | 1        | 4011 Creekwood Terrace LN         | 4/24/15   | Grinder Pump Inop.   |
| 147719 | 1        | 00416 EAST VIEW DR                | 4/24/15   | Grinder Pump Inop @ 418 East View Drive  |
| 147826 | 1        | 06054 BROWNTOWN RD                | 4/28/15   | Red Light is on (Randy Sharp 667-8002)   |
| 147920 | 1        | COLLEGEDALE PUMP STATION          | 4/30/15   | Replace Bleed valve on volute  |
| 147941 | 1        | COLLEGEDALE PUMP STATION          | 4/30/15   | Burning smell coming from the heater going down the stairs.                        |
| 147985 | 1        | RINGGOLD PUMP STATION             | 4/30/15   | Repair Fence Damaged During Robbery (River City Fence)                             |
| 148011 | 1        | RINGGOLD PUMP STATION             | 4/30/15   | Repair wiring from generator to MCC and repair or replace busted out lights caused |
|        |          |                                   |           | by break-in at station. Emergency no quote.  |
| 126330 | 2        | CITICO PUMP STATION #2            | 1/8/14    | Only one heater out of 4 working in pump room, A tall ladder will be needed        |
|        |          |                                   |           | (Artic Weather Event)  |
| 132805 | 2        | ALTAMONT PUMP STATION             | 5/22/14   | Flow meter showing ERROR 2 at station (6") (Southern Sales)                        |
| 133292 | 2        | HIXSON PUMP STATION #2            | 6/4/14    | Repair Flow recorder (See Keith)   |
| 134323 | 2        | WARNER PARK SS #1                 | 6/26/14   | Transducer reading correctly but panel shows HWW Alarm                             |
| 134717 | 2        | MURRAY HILLS #4                   | 7/3/14    | Check electrical on Pump 2/ Megs Bad   |
|        |          |                                   |           | COPY TO MECHANICS TO PULL AND RE-INSTALL Sent to tekwell Request #20382            |
|        |          |                                   |           |  |

| ID     | Priority | Location                       | Initiated | Instructions  |
|--------|----------|--------------------------------|-----------|---|
| 136072 | 2        | TIFTONIA PUMP STATION #1       | 8/5/14    | Flowmeter erratic (Southern Sales)  |
| 137768 | 2        | ALTON PARK PUMP STATION        | 9/10/14   | No LWW alarm reading at Plant   |
| 137859 | 2        | FAGAN STREET PUMP STATION      | 9/12/14   | Check AMP Draw on #2 Pump. Checks bad (COPY TO MECHANICS TO PULL FOR REPAIR)      |
| 138580 | 2        | TIFTONIA PUMP STATION #1       | 9/26/14   | Lights and Fan stay on when tube is closed  |
| 139405 | 2        | BIG RIDGE PUMP STATION #2      | 10/13/14  | Flowmeter reads negative when both pumps off.                                     |
| 139733 | 2        | 23rd STREET PUMP STATION       | 10/17/14  | Calibrate Flow Meters   |
| 139754 | 2        | 19TH STREET PUMP STATION       | 10/17/14  | Check clearances on all 3 pumps   |
| 139891 | 2        | LATTA STREET PUMP STATION      | 10/22/14  | Repack #2 Pump  |
| 140359 | 2        | MOUNTAIN CREEK                 | 11/3/14   | Check wiring on Thermostat. O&C getting high room temp alarm but room temp is     |
|        |          |                                |           | fine  |
| 140372 | 2        | MURRAY HILLS #1                | 11/3/14   | Install LWW Bypass for pumping down station and new H/O/A Switch                  |
| 140444 | 2        | WEST CHICKAMAUGA PUMP STATION  | 11/4/14   | Purge button does not purge line  |
| 142077 | 2        | CITICO PUMP STATION #2         | 12/10/14  | #2 Ball Valve Will Not Close  |
| 142101 | 2        | Warner Park SS #2              | 12/10/14  | Warner Park SS #2 Wet Well Level Control HWW Transducer Inop.                     |
| 142468 | 2        | RINGGOLD PUMP STATION          | 12/18/14  | PURGE BUTTON DOES NOT WOIRK   |
| 142777 | 2        | MOUNTAIN CREEK                 | 1/2/15    | #2 pump check vibration switch. Advise if it is ok                                |
| 142807 | 2        | TIFTONIA PUMP STATION #1       | 1/5/15    | Bypass runs but shows fail at O&C   |
| 143052 | 2        | WEST CHICKAMAUGA PUMP STATION  | 1/7/15    | Flow meter shows wrong GPM  |
| 143120 | 2        | TIFTONIA PUMP STATION #1       | 1/9/15    | #2 Pump Does Not Show In Fail At O&C  |
| 143224 | 2        | DUPONT PARKWAY PUMP STATION    | 1/13/15   | Gravity Flow meter Not recording  |
| 143353 | 2        | MEADOW TRACE PUMP STATION      | 1/15/15   | #1&2 Breakers tripped and shut pumps off but O&C had Indication both were running |
| 143403 | 2        | ALTON PARK PUMP STATION        | 1/15/15   | No HHWW Float alarm , No LWW Alarm, No Pump Fail Alarm, No Intrusion Alarm,       |
|        |          |                                |           | No RTU Alarm all at O&C and O&C doesn't get System on Backup Float Alarm          |
| 143656 | 2        | BOYSCOUT ROAD PUMP STATION     | 1/21/15   | bubble line not reading correctly in O&C  |
| 143678 | 2        | 19TH STREET CSOTF              | 1/21/15   | #1 Pump won't stay on   |
| 143720 | 2        | EAST BRAINERD PUMP STATION     | 1/22/15   | Flow meter not reading flow on #2 & #3 Pumps.(Southern Sales.)                    |
| 143722 | 2        | MOUNTAIN CREEK                 | 1/22/15   | Replacve HHW Float  |
| 143723 | 2        | SOUTH CHICKAMAUGA PUMP STATION | 1/22/15   | #4 Pump RTD Monitor Zone 4&5 Failed Alarm   |
| 143828 | 2        | CITICO PUMP STATION #2         | 1/23/15   | Drywell Supply Fan Keeps Tripping Breaker   |
| 144087 | 2        | SUMMIT LANDFILL STATION #1     | 1/29/15   | Oper. Assist won't stay pressed in  |

### Current PS and CSOTF Work Orders as of May 7, 2015

| ID     | Priority | Location                          | Initiated | Instructions   |
|--------|----------|-----------------------------------|-----------|--|
| 144107 | 2        | CENTRAL AVENUE CSOTF              | 1/30/15   | #8 Cell drain gate won't open (Ice cube Relay?)                                |
| 144127 | 2        | ORCHARD KNOB PUMP STATION         | 1/30/15   | Repair leak in cabinet on bubbler line   |
| 144284 | 2        | HIXSON PUMP STATION #1            | 2/3/15    | Alternator Switches to manual  |
| 144353 | 2        | LATTA STREET PUMP STATION         | 2/4/15    | No HWW or LWW on Bubbler @ O&C   |
| 144491 | 2        | TIFTONIA PUMP STATION #3          | 2/9/15    | install way to purge bubble line   |
| 144573 | 2        | ALTAMONT PUMP STATION             | 2/10/15   | Check for blockage   |
| 144891 | 2        | AIRPORT PUMP STATION #1           | 2/19/15   | replace Dual Seal Fail Relay   |
| 144972 | 2        | AIRPORT PUMP STATION #1           | 2/23/15   | Pull #1 Pump For repair (Seal fail) Sent to tekwell 02/27/2014                 |
| 145007 | 2        | FRIAR BRANCH PUMP STATION         | 2/23/15   | Miltronics Emergency backup didn't come on                                     |
| 145008 | 2        | FRIAR BRANCH PUMP STATION         | 2/23/15   | No Purge on bubble line  |
| 145372 | 2        | CARTER STREET CSOTF               | 3/4/15    | Check gate close parameters at Carter St CSO                                   |
| 145374 | 2        | EAST BRAINERD PUMP STATION        | 3/4/15    | Low Seal Water pressure @ Station  |
| 145375 | 2        | 23rd STREET PUMP STATION          | 3/4/15    | #4 Seal water Solenoid not working   |
| 145524 | 2        | WILLIAMS STREET CSOTF             | 3/6/15    | Large Backflow Flapper Valves in Cell 1&2, 2 of 8 valves still leaking, marked |
|        |          |                                   |           | w/"LEAK" on wall above valves, Questions call Monty 255-6331                   |
| 145709 | 2        | WARNER PARK CSOTF                 | 3/11/15   | #2 Pump Trips out  |
| 145710 | 2        | 19TH STREET PUMP STATION          | 3/11/15   | #1 & 2 Rotomater Inop  |
| 145800 | 2        | BRAINERD GOLF COURSE PUMP STATION | 3/13/15   | Clear Pump #1 and order Cutters & Impeller                                     |
| 145815 | 2        | ENTERPRISE SOUTH INDUSTRIAL PARK  | 3/13/15   | Land Telemetry points for station (TO BE COMPLETED BY 12 PM 3-17-15)           |
| 145856 | 2        | MURRAY HILLS #1                   | 3/13/15   | Leaking sewage   |
| 145982 | 2        | SPRING CREEK PUMP STATION         | 3/18/15   | Increase wire size between breaker and contactor                               |
| 146035 | 2        | 23rd STREET PUMP STATION          | 3/19/15   | Check Pump 3 clearance   |
| 146195 | 2        | BIG RIDGE PUMP STATION #6         | 3/24/15   | Check Pump #2 Contacts Chattering  |
| 146427 | 2        | SOUTH CHICKAMAUGA PUMP STATION    | 3/27/15   | Check oil leak on rear of pump   |
| 146540 | 2        | SOUTH CHICKAMAUGA PUMP STATION    | 4/1/15    | No check valve on Nitrogen tank & Solenoid Inop                                |
| 146669 | 2        | BOYSCOUT ROAD PUMP STATION        | 4/6/15    | LWW Doesn't come in at O&C   |
| 146672 | 2        | BIG RIDGE PUMP STATION #2         | 4/6/15    | Pumps 1 &2 show low current @ O&C  |
| 146673 | 2        | EAST BRAINERD PUMP STATION        | 4/6/15    | 4 Callouts over weekend for RTU Fail   |
| 146729 | 2        | MURRAY HILLS #1                   | 4/7/15    | #2 Pump mechanical seal leaking  |
| 146929 | 2        | 23rd STREET PUMP STATION          | 4/9/15    | Pumps in fail, doesn't show at O&C   |
| 146931 | 2        | 23rd STREET PUMP STATION          | 4/9/15    | #2 pump seal water solenoid stuck open   |
| 147121 | 2        | ORCHARD KNOB PUMP STATION         | 4/15/15   | replace rotameter (INOP)   |
| 147158 | 2        | 19TH STREET CSOTF                 | 4/15/15   | PLC QuickPanel keeps re-booting  |

### Current PS and CSOTF Work Orders as of May 7, 2015

| ID     | Priority | Location                                     | Initiated | Instructions   |
|--------|----------|--|-----------|--|
| 147371 | 2        | ORCHARD KNOB PUMP STATION                    | 4/20/15   | Need station lighting outside.   |
| 147373 | 2        | MT CREEK                                     | 4/20/15   | Lead air compressor will not run.  |
| 147374 | 2        | CITICO PUMP STATION #2                       | 4/20/15   | Water running down wall on crane disconnect. Laborers to inspect first.                |
| 147384 | 2        | ORCHARD KNOB PUMP STATION                    | 4/20/15   | Pump #1 keeps failing @ the drive  |
| 147389 | 2        | 19TH STREET REGULATOR                        | 4/20/15   | Clean line from downstream chamber to next manhole.                                    |
| 147396 | 2        | SOUTH CHICKAMAUGA PUMP STATION               | 4/20/15   | Pump 1 is pumping about half as much as the other pumps                                |
| 147401 | 2        | MURRAY HILLS #5                              | 4/20/15   | Repair station lighting outside  |
| 147408 | 2        | TIFTONIA PUMP STATION #1                     | 4/20/15   | Bypass pump shows in fail, but is still running. It will not run in hand.              |
| 147454 | 2        | TIFTONIA PUMP STATION #1                     | 4/20/15   | Probe #1 is bad.   |
| 147459 | 2        | ENTERPRISE SOUTH INDUSTRIAL PARK: Pump<br>#1 | 4/20/15   | Pull pump #1 and check for blockage/repair.  |
| 147608 | 2        | TIFTONIA PUMP STATION #1                     | 4/22/15   | Adjust bypass check valve.   |
| 147610 | 2        | CITICO PUMP STATION #2                       | 4/22/15   | #4 pump vibration and check clearance.   |
| 147673 | 2        | MURRAY HILLS #5                              | 4/23/15   | Dehumidifier is leaking (3/4or 1" to 3/8 poly).  |
| 147731 | 2        | FRIAR BRANCH PUMP STATION                    | 4/24/15   | Need light on Emergency System to tell when on.  |
| 147770 | 2        | LAKE VISTA PUMP STATION                      | 4/27/15   | Pump 2 will not run. Check phase monitor or pull and check pump if needed.             |
| 147944 | 2        | LAKE VISTA PUMP STATION                      | 4/30/15   | Pump #2 is bad. Pull for repair.   |
| 147946 | 2        | LAKE VISTA PUMP STATION                      | 4/30/15   | Repalce discharge valve on pump 1 and pump 2.  |
| 147952 | 2        | CARTER STREET CSOTF                          | 4/30/15   | Clean walkway and disinfect chamber and inlet room.                                    |
| 148085 | 2        | TIFTONIA PUMP STATION #1                     | 5/4/15    | Repair/replace photo eye in automatic light on station.                                |
| 148089 | 2        | FRIAR BRANCH PUMP STATION                    | 5/4/15    | Repair/replace lights at pump station.   |
| 148105 | 2        | COLLEGEDALE PUMP STATION                     | 5/4/15    | Replace discharge valves on all four pumps.  |
| 148173 | 2        | WILLIAMS STREET CSOTF                        | 5/6/15    | Check flow meter.  |
| 148274 | 2        | AIRPORT PUMP STATION #1                      | 5/7/15    | Install new pump at pump station 1, pump 1.  |
| 148303 | 2        | WARNER PARK SS #1                            | 5/7/15    | Replace level gauge at Storm Station 1.  |
| 106112 | 3        | MT CREEK                                     | 1/10/13   | rebuild ball valve cylinder Parts In shop 11-27-13                                     |
| 112399 | 3        | STORM STATION #3                             | 4/24/13   | Provide quote for electric actuator installation on Sluice Gate. Req. # 16264 (Guthrie |
|        |          |  |           | Sales Quote \$3,986){W7954} SCOPE CHANGE   |
| 115514 | 3        | TIFTONIA PUMP STATION #3                     | 6/19/13   | The tubing used with gas meters to check the tube environment for gas Change to        |
|        |          |  |           | the proper size at all tube stations   |
| 116941 | 3        | MURRAY HILLS #5                              | 7/15/13   | Spray weed killer at station (from a PM)   |
| 119764 | 3        | CITICO CSOTF                                 | 9/4/13    | Replace Water hose fittings  |

### Current PS and CSOTF Work Orders as of May 7, 2015

| ID     | Priority | Location                   | Initiated | Instructions  |
|--------|----------|----------------------------|-----------|---|
| 120246 | 3        | MEADOW TRACE PUMP STATION  | 9/12/13   | Seal new privacy fence at Meadow Trace REQ 21040                                      |
| 120502 | 3        | EASTGATE PUMP STATION #1   | 9/16/13   | SEAL PRIVACY FENCE  |
| 120503 | 3        | BATTERY PLACE PUMP STATION | 9/16/13   | SEAL PRIVACY FENCE  |
| 120504 | 3        | TIFTONIA PUMP STATION #2   | 9/16/13   | SEAL PRIVACY FENCE  |
| 123279 | 3        | CENTRAL AVENUE CSOTF       | 11/7/13   | Get oil dry mats for Central CSO  |
| 124435 | 3        | SIDNEY STREET REGULATOR    | 11/27/13  | Sidney gate will not close all the way, flow coming through.                          |
|        |          |                            |           | Turn over to electricians when gate is mechanically able to close for them to adjust  |
|        |          |                            |           | the EIM limits.   |
| 125995 | 3        | FRIAR BRANCH PUMP STATION  | 12/30/13  | Flowmeter pump 2 not working (Southern Sales)   |
| 126696 | 3        | DUPONT INDUSTRIAL PARK     | 1/15/14   | Install Heat tape (Weather)   |
| 126700 | 3        | MURRAY HILLS #2            | 1/15/14   | Install Heat tape (Weather)   |
| 126701 | 3        | TREMONT CSOTF              | 1/15/14   | Install Heat tape (Weather)   |
| 128882 | 3        | HIXSON PUMP STATION #1     | 3/5/14    | Repair volute and install wear rings H&H Brown (\$1550)                               |
| 130746 | 3        | WARNER PARK CSOTF          | 4/9/14    | Lights staying on outside station 24/7  |
| 131234 | 3        | TIFTONIA PUMP STATION #2   | 4/22/14   | Run/Flow indicator LED out  |
| 131342 | 3        | MT CREEK                   | 4/23/14   | Paint hand rails and guards safety yellow   |
| 133316 | 3        | BIG RIDGE PUMP STATION #2  | 6/4/14    | Inspect Pump Bases for wear WAITING ON DIRECTION                                      |
| 134098 | 3        | BIG RIDGE PUMP STATION #5  | 6/23/14   | Extend inlet Pipe to below water level in Wetwell to reduce turbulence IN ENGINEERING |
| 134904 | 3        | HIXSON PUMP STATION #3     | 7/8/14    | Mechanical Seal Leaking   |
|        |          |                            |           | Copy To Electricians To Un-wire Waiting on seal housing REQ# 134904                   |
| 135035 | 3        | CARTER STREET CSOTF        | 7/11/14   | Install Galvanized Wall around Fine Screen WAITING ON APPROVAL                        |
| 136173 | 3        | TIFTONIA PUMP STATION #2   | 8/7/14    | Replace Drain on air relief   |
| 136379 | 3        | ALTAMONT PUMP STATION      | 8/12/14   | Reschedule RTU points   |
| 136862 | 3        | Highland Park Pump Station | 8/22/14   | Pump 3 motor megs bad. (COPY TO MECHANICS TO PULL)                                    |
| 137780 | 3        | CITICO PUMP STATION #2     | 9/11/14   | Replace lamps in indicator lights as needed   |
| 138240 | 3        | CITICO PUMP STATION #2     | 9/19/14   | Repair Overhead Crane in Dry Well   |
| 138759 | 3        | MURRAY HILLS #1            | 9/30/14   | #2 Pump Discharge Valve Leaking   |
| 138921 | 3        | ALTON PARK PUMP STATION    | 10/2/14   | Float level system not showing in SCADA   |
| 139039 | 3        | HIXSON PUMP STATION #1     | 10/6/14   | Drywell exhaust fan runs after lid closes   |
| 139051 | 3        | MURRAY HILLS #4            | 10/7/14   | Operator Assist not working at Murray Hills #4  |
| 139090 | 3        | HIGHLAND PARK PUMP STATION | 10/7/14   | Diversion gate closed light not working   |

| ID     | Priority | Location                       | Initiated | Instructions  |
|--------|----------|--------------------------------|-----------|---|
| 139258 | 3        | CITICO PUMP STATION #2         | 10/9/14   | Site Intrusion Alarm Inop   |
| 139438 | 3        | WARNER PARK CSOTF              | 10/14/14  | O&C not recieving interceptor, screen sewer, and facility levels                      |
| 140017 | 3        | LATTA STREET PUMP STATION      | 10/24/14  | REMOVE AND REPLACE BOTH SUCTION ISOLATION VALVES                                      |
| 140104 | 3        | MLK CSOTF                      | 10/28/14  | Intrusion Alarm Not Working   |
| 140269 | 3        | 23rd STREET PUMP STATION       | 10/30/14  | Cannot Move Rake bar Bypass gate  |
| 140413 | 3        | 19TH STREET PUMP STATION       | 11/4/14   | Replace UPS   |
| 140497 | 3        | HIXSON PUMP STATION #2         | 11/5/14   | Replace Terminal strips with Circuit Breakers in Control panel                        |
| 140532 | 3        | ALTAMONT PUMP STATION          | 11/5/14   | Repair 4" Carbon filter next to Manhole and install new cartridge Filter.(Location on |
|        |          |                                |           | Oxford off Old dallas Rd.)  |
| 140535 | 3        | BIG RIDGE PUMP STATION #1      | 11/5/14   | repair non working ARV on Force Main at 4935 Gann Store Rd.                           |
|        |          |                                |           | (IN ROAD! TRAFFIC CONTROL REQUIRED! Turn left on Gann Store Rd instead of right       |
|        |          |                                |           | to go to Station)   |
| 140921 | 3        | CITICO CSOTF                   | 11/12/14  | Check heaters for proper operation in MCC and Bathroom                                |
| 140982 | 3        | WARNER PARK SS #1              | 11/13/14  | HWW & LWW not coming in to O&C  |
| 140999 | 3        | SPRING CREEK PUMP STATION      | 11/13/14  | ON 11-20-14 TO CLEAN OUT THE BIOXIDE STORAGE (CO-ORDINATE WITH BILL                   |
|        |          |                                |           | NEWELL)   |
| 141262 | 3        | 19TH STREET PUMP STATION       | 11/20/14  | Install switch to prevent UPS Fail from shutting down entire Station                  |
| 141265 | 3        | 23rd STREET PUMP STATION       | 11/20/14  | Install switch to prevent UPS Fail from shutting down entire Station                  |
| 141267 | 3        | CITICO PUMP STATION #2         | 11/20/14  | Install switch to prevent UPS Fail from shutting down entire Station                  |
| 141268 | 3        | FRIAR BRANCH PUMP STATION      | 11/20/14  | Install switch to prevent UPS Fail from shutting down entire Station                  |
| 141269 | 3        | MOUNTAIN CREEK:                | 11/20/14  | Install switch to prevent UPS Fail from shutting down entire Station                  |
| 141270 | 3        | ORCHARD KNOB PUMP STATION:     | 11/20/14  | Install switch to prevent UPS Fail from shutting down entire Station                  |
| 141271 | 3        | SOUTH CHICKAMAUGA PUMP STATION | 11/20/14  | Install switch to prevent UPS Fail from shutting down entire Station                  |
| 141372 | 3        | CITICO CSOTF                   | 11/24/14  | miltronics not working right  |
| 141389 | 3        | HIXSON PUMP STATION #2         | 11/24/14  | R&R FLOWMETER (Southern Sales)  |
| 141815 | 3        | SOUTH CHICKAMAUGA PUMP STATION | 12/4/14   | Get Tissue paper & other cleaning supplies  |
| 142030 | 3        | HIXSON PUMP STATION #1         | 12/9/14   | Replace pen on #1 Flow Recorder   |
| 142146 | 3        | ORCHARD KNOB PUMP STATION      | 12/11/14  | Check Electrical on Pump #1 Seal water solenoid                                       |
| 142232 | 3        | 23rd STREET PUMP STATION       | 12/12/14  | Replace wear rings on #3 pump   |
| 142451 | 3        | COLLEGEDALE PUMP STATION       | 12/18/14  | Replace cone valve on pump #1 with Check valve  |
| 142452 | 3        | COLLEGEDALE PUMP STATION       | 12/18/14  | Replace cone valve on pump #2 with Check valve  |
| 142454 | 3        | COLLEGEDALE PUMP STATION       | 12/18/14  | Replace cone valve on pump #3 with Check valve  |
| 142542 | 3        | RINGGOLD PUMP STATION          | 12/22/14  | Outside light are out   |

| Current PS and CSOTF Work Orders as of May 7, 2015 |
|--|
|--|

| ID     | Priority | Location                       | Initiated | Instructions   |
|--------|----------|--------------------------------|-----------|--|
| 142548 | 3        | VAAP PLANT                     | 12/22/14  | station Light out  |
| 142549 | 3        | 19TH STREET PUMP STATION       | 12/22/14  | #3 Pumping below 7" setpoint   |
| 142694 | 3        | FRIAR BRANCH PUMP STATION      | 12/30/14  | Install a rack of 3 Portable Generator Plugs w/Kirk Key Interlock and a Disconnect on Each One. Wire up one plug to each pump/VFD. Install an outside 110V electrical outlet beside Generator Plugs. (See Allen Martin for location and questions) |
| 142891 | 3        | Warner Park SS #2              | 1/6/15    | LW Float Not Working   |
| 142893 | 3        | Warner Park SS #2              | 1/6/15    | Install Intrusion Alarm  |
| 142901 | 3        | SOUTH CHICKAMAUGA PUMP STATION | 1/6/15    | Install one QED-2 Quick Connect Generator Switchboard. Disable and remove existing Welder Plug and move Operator Assist Button out for better access.  |
| 143055 | 3        | FRIAR BRANCH PUMP STATION      | 1/7/15    | Check packing on all 3 pumps   |
| 143219 | 3        | CITICO PUMP STATION #2         | 1/13/15   | Bathroom Exhaust Fan inop  |
| 143339 | 3        | BIG RIDGE PUMP STATION #1      | 1/15/15   | Operator assist keeps coming in to O&C (Nuisance Alarm)  |
| 143361 | 3        | ORCHARD KNOB PUMP STATION      | 1/15/15   | Heater is not working  |
| 143363 | 3        | ORCHARD KNOB PUMP STATION      | 1/15/15   | South end fan needs belt (A44)   |
| 143531 | 3        | SPRING CREEK PUMP STATION      | 1/20/15   | Install pressure guages on Static side of Check Valve (AFTER CHECK VALVE) all 3 pumps  |
| 143557 | 3        | TIFTONIA PUMP STATION #2       | 1/20/15   | operator assist inop and led's Flow & Run Inop   |
| 143655 | 3        | BIG RIDGE PUMP STATION #6      | 1/21/15   | #2 doesn't show running in O&C   |
| 143657 | 3        | TIFTONIA PUMP STATION #1       | 1/21/15   | #2 Check valve slams shut  |
| 143905 | 3        | 23rd STREET PUMP STATION       | 1/27/15   | Clalibrate Flow Meters   |
| 143906 | 3        | ORCHARD KNOB PUMP STATION      | 1/27/15   | #1 Pump Seal Water solenoid No Power   |
| 144108 | 3        | MLK CSOTF                      | 1/30/15   | Odor Control "Flow Alarm" No lights in MCC Room / Will reset but kicks off (Pressure Differential Fluid in guage Low)  |
| 144286 | 3        | SOUTH CHICKAMAUGA PUMP STATION | 2/3/15    | Install Outlet in Drive Room (See Luther)  |
| 144287 | 3        | SOUTH CHICKAMAUGA PUMP STATION | 2/3/15    | Install Lights in Drive and rake room  |
| 144400 | 3        | DUPONT PARKWAY PUMP STATION    | 2/5/15    | Gravity Flow Meter inop  |
| 144475 | 3        | TIFTONIA PUMP STATION #3       | 2/6/15    | Will not come on in auto.  |
| 144540 | 3        | HIGHLAND PARK PUMP STATION     | 2/10/15   | Air compressor in Control panel won't come on  |
| 144568 | 3        | ALTAMONT PUMP STATION          | 2/10/15   | OL Relay Fault on Pump #2  |
| 144720 | 3        | MLK CSOTF                      | 2/13/15   | EF1 & EF2 won't run  |
| 144770 | 3        | MURRAY HILLS #2                | 2/17/15   | Investigate Power Failures at station  |

| ID     | Priority | Location                       | Initiated | Instructions  |
|--------|----------|--------------------------------|-----------|---|
| 144773 | 3        | RIVER PARK #1                  | 2/17/15   | Make up Adapter For RTU Router  |
| 144774 | 3        | RIVER PARK #2                  | 2/17/15   | Make up Adapter For RTU Router  |
| 144777 | 3        | DUPONT METER STATION           | 2/17/15   | Checked recorder Intrusion and Operator assist alarm                                |
| 144828 | 3        | COLLEGEDALE PUMP STATION       | 2/18/15   | Check arm fell off on #1 and #3 has bad seal on cone valve                          |
| 145003 | 3        | AIRPORT PUMP STATION #1        | 2/23/15   | Install lights over control panel (SEE LUTHER)                                      |
| 145006 | 3        | HIXSON PUMP STATION #3         | 2/23/15   | Mechanical seal leaking   |
| 145361 | 3        | SPRING CREEK PUMP STATION      | 3/4/15    | Replace the 3 Pump Disconnects.   |
| 145363 | 3        | DUPONT PARKWAY PUMP STATION    | 3/4/15    | Disable Shunt-trip on Circuit Breaker.  |
| 145377 | 3        | 19TH STREET PUMP STATION       | 3/4/15    | No HHWW alarm in O&C  |
| 145385 | 3        | 23rd STREET PUMP STATION       | 3/5/15    | Repack #4 Pump  |
| 145386 | 3        | EAST BRAINERD PUMP STATION     | 3/5/15    | Replace Cord Reel   |
| 145422 | 3        | SOUTH CHICKAMAUGA PUMP STATION | 3/5/15    | Clean wet well  |
| 145563 | 3        | STORM STATION #3               | 3/9/15    | Repair Fence section damaged by car wreck.  |
| 145590 | 3        | TIFTONIA PUMP STATION #1       | 3/9/15    | Check and or Repair ARV 4 (By River Crossing Sign on Side by Golf Course) ARV 5 & 6 |
|        |          |                                |           | (in the woods SE of the golf Course) and ARV 6 (on Mocassin Bend Rd before Golf     |
|        |          |                                |           | Course Driveway)  |
| 145656 | 3        | BIG RIDGE PUMP STATION #1      | 3/11/15   | Cut down and dispose of debris of five trees, not including stumps.                 |
| 145670 | 3        | 26TH STREET PUMP STATION       | 3/11/15   | Rebuild Control panel (Like Komatsu & Battery Place)                                |
| 145671 | 3        | LAKE VISTA PUMP STATION        | 3/11/15   | Rebuild Control panel (Like Komatsu & Battery Place)                                |
| 145711 | 3        | HIGHLAND PARK PUMP STATION     | 3/11/15   | No intrusion Alarm @ Station  |
| 145712 | 3        | HIGHLAND PARK PUMP STATION     | 3/11/15   | No Pump Fail @ O&C  |
| 145810 | 3        | MURRAY HILLS #4                | 3/13/15   | Replace pump #2   |
| 145858 | 3        | 23rd STREET PUMP STATION       | 3/13/15   | #1 pump Failed but didn't show in O&C   |
| 145936 | 3        | 02110 WISTERIA DR              | 3/16/15   | Home owner (Mr. Ron Speicher PH. 593-7001) wants Grinder Pump Control Moved         |
| 145963 | 3        | CARTER STREET CSOTF            | 3/17/15   | Replace lights as needed, document what needs repair.                               |
| 145965 | 3        | 19TH STREET PUMP STATION       | 3/17/15   | Repair Emergency Light & Lights in WW and Lights on 2nd Flr.                        |
| 145967 | 3        | MURRAY HILLS #2                | 3/17/15   | Control cabinet Won't close properly  |
| 145969 | 3        | VAAP PLANT                     | 3/17/15   | Trouble shoot and repair issues with transmitter                                    |
| 146033 | 3        | BIG RIDGE PUMP STATION #1      | 3/19/15   | Mount Hand Operated cable Jib like we have for injector pumps (SEE DAMON FOR        |
|        |          |                                |           | LOCATION)   |

| ID     | Priority | Location                       | Initiated | Instructions   |
|--------|----------|--------------------------------|-----------|--|
| 146034 | 3        | BIG RIDGE PUMP STATION #5      | 3/19/15   | Mount Hand Operated cable Jib like we have for injector pumps (SEE DAMON FOR       |
|        |          |                                |           | LOCATION)  |
| 146418 | 3        | CITICO PUMP STATION #2         | 3/27/15   | Repair drains on #3 & #4 Pumps   |
| 146425 | 3        | 19TH STREET PUMP STATION       | 3/27/15   | WW Operator Assist inop  |
| 146544 | 3        | CARTER STREET CSOTF            | 4/1/15    | Replace filters all 4 Cells (Some Missing)   |
| 146548 | 3        | STORM STATION #3               | 4/1/15    | Run conduit to actuator  |
| 146576 | 3        | DUPONT PARKWAY PUMP STATION    | 4/2/15    | Wash down Valve leaking by (Mechanics checked already)                             |
| 146652 | 3        | CITICO PUMP STATION #2         | 4/6/15    | Unwire Pump & re wire when it returns (WRD ELECTRICIANS) Pull Pump & re-install    |
|        |          |                                |           | after repair (H&H)   |
| 146665 | 3        | HIXSON PUMP STATION #2         | 4/6/15    | HWW Alarm doesn't come in at O&C/ LWW does not work on Multi smart                 |
| 146674 | 3        | SOUTH CHICKAMAUGA PUMP STATION | 4/6/15    | Lights in old force main valve pit out (Solenoid?)                                 |
| 146727 | 3        | CITICO PUMP STATION #2         | 4/7/15    | Install GE HMI Touchscreen for Alarm Panel (ADMAN ELECTRIC) {PLC CONTRACT}         |
|        |          |                                |           |  |
| 146732 | 3        | FRIAR BRANCH PUMP STATION      | 4/7/15    | Repair Light Fixtures  |
| 146737 | 3        | ALTAMONT PUMP STATION          | 4/7/15    | Clean wetwell  |
| 146738 | 3        | BATTERY PLACE PUMP STATION     | 4/7/15    | Clean wetwell  |
| 147157 | 3        | SUMMIT LANDFILL STATION #1     | 4/15/15   | Operator Assist button broken  |
| 147398 | 3        | FRIAR BRANCH PUMP STATION      | 4/20/15   | Bird Bath on Pumps 1, 2, & 3 are spraying water out onto the floor. Needs replaced |
|        |          |                                |           | or unclogged   |
| 147399 | 3        | MURRAY HILLS #5                | 4/20/15   | Wet well needs cleaning  |
| 147404 | 3        | MURRAY HILLS #5                | 4/20/15   | Pump room emergency lights are not working   |
| 147416 | 3        | MURRAY HILLS #5                | 4/20/15   | Replace bubble line air flowmeter & reg  |
| 147613 | 3        | 19TH STREET PUMP STATION       | 4/22/15   | Install new intrusion switch on CPU unit and new switch operator assist button.    |
|        |          |                                |           |  |
| 147674 | 3        | MURRAY HILLS #5                | 4/23/15   | The light in coffin does not work.   |
| 147728 | 3        | MURRAY HILLS #7                | 4/24/15   | Need 3 - 1/4" valves replaced and 2 - 90 installed.                                |
| 147729 | 3        | MURRAY HILLS #6                | 4/24/15   | Site Intrusion alarm does not come into O&C.                                       |
| 147730 | 3        | MURRAY HILLS #2                | 4/24/15   | Clean wet well.  |
| 147767 | 3        | SPRING CREEK PUMP STATION      | 4/27/15   | Install new light under control panel (Like the one at Pineville)                  |
| 147948 | 3        | LAKE VISTA PUMP STATION        | 4/30/15   | The brace in the wet well has deteriorated.  |
| 147970 | 3        | FRIAR BRANCH PUMP STATION      | 4/30/15   | HVAC Short Cycling   |
| 148045 | 3        | CARTER STREET CSOTF            | 5/1/15    | Clean Walk Way   |

| ID     | Priority | Location                    | Initiated | Instructions  |  |  |  |  |
|--------|----------|-----------------------------|-----------|---|--|--|--|--|
| 148119 | 3        | EAST BRAINERD PUMP STATION  | 5/5/15    | Check for blockages in pump 2 and pump 3. Pump 2 is not pumping as musch as pump 3. |  |  |  |  |
| 148120 | 3        | EAST BRAINERD PUMP STATION  | 5/5/15    | Valves for pump 1 and 2 are leaking onto floor.                                     |  |  |  |  |
| 148121 | 3        | BIG RIDGE PUMP STATION #1   | 5/5/15    | Clean Wet Well  |  |  |  |  |
| 148122 | 3        | BIG RIDGE PUMP STATION #6   | 5/5/15    | Repair flow meter. (Southern Sales)   |  |  |  |  |
| 148124 | 3        | Heritage Green Pump Station | 5/5/15    | Clean Wet Well  |  |  |  |  |
| 148126 | 3        | TREMONT CSOTF               | 5/5/15    | Replace the top guide rail bracket on the sample pump. Check the bottom connection. |  |  |  |  |
| 148158 | 3        | 19TH STREET PUMP STATION    | 5/6/15    | Replace belts on drywell fan.   |  |  |  |  |
| 148161 | 3        | MLK CSOTF                   | 5/6/15    | Replace And Calibrate Faulted Engine Interface Module.                              |  |  |  |  |
| 148187 | 3        | ALTAMONT PUMP STATION       | 5/6/15    | Clean Wet Well  |  |  |  |  |

# Appendix J Completed PS and CSOTF Work Orders

| ID     | Priority | Actual     | Actual         | Location                       |          | Closed  | Instructions  |
|--------|----------|------------|----------------|--------------------------------|----------|---------|---|
|        |          | Start Date | Finish<br>Date |                                | Date     | Date    |   |
| 143113 | 1        | 3/6/15     | 3/6/15         | ORCHARD KNOB STORM STATION     | 1/9/15   | 3/10/15 | Miltronics going in and out on high level.            |
| 145446 | 1        | 3/5/15     | 3/5/15         | HIGHLAND PARK PUMP STATION     | 3/5/15   | 3/10/15 | Replace Phase Monitor on Pump #1                      |
| 145562 | 1        | 3/7/15     | 3/7/15         | EAST BRAINERD PUMP STATION     | 3/9/15   | 3/10/15 | #2 check Valve stopped Up (CALL OUT)                  |
| 145543 | 1        | 3/6/15     | 3/6/15         | SPRING CREEK PUMP STATION      | 3/6/15   | 3/11/15 | Pump 2 tripping out                                   |
| 145561 | 1        | 3/9/15     | 3/9/15         | SOUTH CHICKAMAUGA PUMP STATION | 3/9/15   | 3/11/15 | #3 Discharge ball valve goes into Fail On Close       |
| 144251 | 1        | 2/3/15     | 2/3/15         | BRAINERD MANOR PUMP STATION    | 2/3/15   | 3/13/15 | Replace Air Compressor                                |
| 145559 | 1        | 3/9/15     | 3/9/15         | BIG RIDGE PUMP STATION #7      | 3/9/15   | 3/13/15 | RTU Comm Fail   |
| 145611 | 1        | 3/10/15    | 3/10/15        | BIG RIDGE PUMP STATION #1      | 3/10/15  | 3/13/15 | R & R LWW float                                       |
| 145718 | 1        | 3/12/15    | 3/12/15        | MEADOW TRACE PUMP STATION      | 3/12/15  | 3/13/15 | Replace blown Capacitor                               |
| 141116 | 1        | 11/17/14   | 3/5/15         | SOUTH CHICKAMAUGA PUMP STATION | 11/17/14 | 3/16/15 | HVAC froze Up   |
| 145806 | 1        | 3/13/15    | 3/13/15        | SIDNEY STREET REGULATOR        | 3/13/15  | 3/18/15 | Gate won't operate by program, will open and close in |
|        |          |            |                |                                |          |         | manual  |
| 145884 | 1        | 3/16/15    | 3/16/15        | LATTA STREET PUMP STATION      | 3/16/15  | 3/18/15 | Check LWW Float & LWW Relay                           |
| 144740 | 1        | 2/14/15    | 2/15/15        | HERITAGE GREEN PUMP STATION    | 2/16/15  | 3/19/15 | R& R Floats as needed (CALL OUT)                      |
| 145881 | 1        | 3/13/15    | 3/14/15        | SOUTH CHICKAMAUGA PUMP STATION | 3/16/15  | 3/19/15 | Power Failure @ Station (CALL OUT)                    |
| 145202 | 1        | 3/2/15     | 3/4/15         | 22nd STREET PUMP STATION       | 3/2/15   | 3/26/15 | Water In Oil  |
| 146113 | 1        | 3/20/15    | 3/20/15        | EAST BRAINERD PUMP STATION     | 3/20/15  | 4/9/15  | Pump #1 Will Not Run                                  |
| 145510 | 1        | 3/6/15     | 3/9/15         | EAST BRAINERD PUMP STATION     | 3/6/15   | 4/14/15 | Cord reel Bad   |
| 138262 | 1        | 9/22/14    | 4/1/15         | CITICO PUMP STATION #2         | 9/22/14  | 4/14/15 | Troubleshoot pump controls to get station back on     |
|        |          |            |                |                                |          |         | line. Week end call out.                              |
| 132170 | 1        | 1/19/15    | 3/16/15        | SOUTH CHICKAMAUGA PUMP STATION | 5/8/14   | 4/16/15 | Check pump 1 for blockage 6/2 needs impeller          |
| 146433 | 1        | 3/27/15    | 3/27/15        | HIXSON PUMP STATION #3         | 3/27/15  | 4/17/15 | Pull and Check for Blockage                           |
| 146434 | 1        | 3/27/15    | 3/27/15        | HIXSON PUMP STATION #3         | 3/27/15  | 4/17/15 | Check vibration on Pump #3 (Blockage?)                |
| 146474 | 1        | 3/30/15    | 3/30/15        | EAST BRAINERD PUMP STATION     | 3/30/15  | 4/17/15 | Repair Bubble Line                                    |
| 146553 | 1        | 4/1/15     | 4/2/15         | CITICO PUMP STATION #2         | 4/2/15   | 4/17/15 | #4 Drive failed                                       |
| 146479 | 1        | 3/16/15    | 4/9/15         | FRIAR BRANCH PUMP STATION      | 3/30/15  | 4/17/15 | HVAC is inop  |
| 146654 | 1        | 4/6/15     | 4/6/15         | SOUTH CHICKAMAUGA PUMP STATION | 4/6/15   | 4/17/15 | Guide rail seperated that rakes ride on . Needs       |
|        |          |            |                |                                |          |         | welding   |
| 146698 | 1        | 4/7/15     | 4/7/15         | EASTGATE PUMP STATION #1       | 4/6/15   | 4/22/15 | Replace LWW Float                                     |

| ID     | Priority | Actual<br>Start Date | Actual<br>Finish<br>Date | Location                       | Initiated<br>Date | Closed<br>Date | Instructions  |
|--------|----------|----------------------|--------------------------|--------------------------------|-------------------|----------------|---|
| 146728 | 1        | 4/7/15               |                          | MURRAY HILLS #1                | 4/7/15            | 4/22/15        | RTU COMM FAIL   |
|        |          |                      |                          |                                |                   |                | Changed from Electrician to TRIAD 4/22/15 Antenna connection water proofing has failed. Dry out connection, clean and inspect then re-seal. |
| 147297 | 1        | 4/17/15              | 4/17/15                  | TIFTONIA PUMP STATION #2       | 4/17/15           | 4/29/15        | Pump 1 and Pump 2 both short cycling  |
| 147357 | 1        | 4/18/15              | 4/20/15                  | WARNER PARK CSOTF              | 4/20/15           | 4/29/15        | Jet-out storm drains around ball park.  |
| 147823 | 1        | 4/28/15              | 4/28/15                  | CITICO PUMP STATION #2         | 4/28/15           | 5/1/15         | Repair bubble line.   |
| 145891 | 1        | 4/21/15              | 4/30/15                  | EAST BRAINERD PUMP STATION     | 3/16/15           | 5/6/15         | Roof leak @ Control Building  |
| 144522 | 2        | 3/20/15              | 3/27/15                  | LATTA STREET PUMP STATION      | 4/23/15           | 2/9/15         | RTU Intermittent (Battery?)   |
| 137771 | 2        | 3/5/15               | 3/5/15                   | EAST BRAINERD PUMP STATION     | 9/10/14           | 3/9/15         | When lag sump pump is plugged up it trips Circuit   |
|        |          |                      |                          |                                |                   |                | Breaker #3 and kills elevator and lights  |
| 141029 | 2        | 3/2/15               | 3/2/15                   | 26TH STREET PUMP STATION       | 11/14/14          | 3/10/15        | Low WW Float doesn't turn off pumps   |
| 144538 | 2        | 3/3/15               | 3/3/15                   | TIFTONIA PUMP STATION #3       | 2/10/15           | 3/10/15        | Replace Phase Monitor on Elevator   |
| 145401 | 2        | 3/6/15               | 3/6/15                   | RCHARD KNOB STORM STATION      | 3/5/15            | 3/10/15        | miltronics in Alarm (LOE)   |
| 141035 | 2        | 1/26/15              | 3/9/15                   | CENTRAL AVENUE CSOTF           | 11/14/14          | 3/11/15        | Check & Repair Heaters all 4 buildings  |
| 144713 | 2        | 3/9/15               | 3/9/15                   | COLLEGEDALE PUMP STATION       | 2/13/15           | 3/11/15        | Repack #4 Pump  |
| 142805 | 2        | 1/5/15               | 1/7/15                   | CITICO PUMP STATION #2         | 1/5/15            |                | Check Motor was started, smoked and then won't restart (COPY TO MECHANICS TO PULL MOTOR AND   |
|        |          |                      |                          |                                |                   |                | RE-INSTALL AFTER REPAIR)  |
| 145707 | 2        | 3/11/15              | 3/11/15                  | FRIAR BRANCH PUMP STATION      | 3/11/15           | 3/13/15        | Insulate hour meter connections (Closing door cause it to trip)   |
| 145840 | 2        | 3/16/15              | 3/16/15                  | PINEVILLE PUMP STATION         | 3/13/15           | <b>.</b>       | Pull Both pumps and check for blockage  |
| 145941 | 2        | 3/17/15              |                          | DUPONT INDUSTRIAL PARK         | 3/17/15           |                | Pull and check for blockage   |
| 145942 | 2        | 2/17/15              |                          | BIG RIDGE PUMP STATION #1      | 3/17/15           |                | Pump 2 Fell Over  |
| 145886 | 2        | 3/17/15              |                          | LATTA STREET PUMP STATION      | 3/16/15           | 3/18/15        | Check high vibration on air compressor and replace pressure guage   |
| 145888 | 2        | 3/16/15              | 3/16/15                  | LATTA STREET PUMP STATION      | 3/16/15           | +              | Panel off on heater and exposed wires   |
| 145515 | 2        | 3/9/15               |                          | SOUTH CHICKAMAUGA PUMP STATION | 3/6/15            |                | Set up or Repair Pump Emergency System Control  |

| ID     | Priority | Actual<br>Start Date | Actual<br>Finish<br>Date | Location                       | Initiated<br>Date | Closed<br>Date | Instructions   |
|--------|----------|----------------------|--------------------------|--------------------------------|-------------------|----------------|--|
| 146027 | 2        | 3/24/15              |                          | SOUTH CHICKAMAUGA PUMP STATION | 3/19/15           | 3/26/15        | Pump #2 Making Noise. Operator requests check by Chief Mechanic  |
| 145983 | 2        | 3/20/15              | 3/20/15                  | BIG RIDGE PUMP STATION #1      | 3/18/15           | 3/26/15        | Run tube from Air Relief to WW   |
| 145517 | 2        | 3/6/15               | 4/2/15                   | MT CREEK                       | 3/6/15            | 4/7/15         | Low Level Oil Limit switch broken  |
| 145522 | 2        | 3/6/15               | 3/6/15                   | HIXSON PUMP STATION # 1        | 3/6/15            | 4/7/15         | Check for Blockage reopened by Dan on 4/08/2015  |
| 141088 | 2        | 11/14/14             | 11/14/14                 | TREMONT CSOTF                  | 11/14/14          | 4/9/15         | Influent Channel Miltronics Erratic  |
| 141364 | 2        | 12/5/14              | 12/8/14                  | SOUTH CHICKAMAUGA PUMP STATION | 11/24/14          | 4/9/15         | Insufficient power to Controls for Nitrogen Backup System  |
| 143119 | 2        | 3/17/15              | 3/17/15                  | WARNER PARK SS #2              | 1/9/15            | 4/9/15         | Pull Pump: Seal Fail   |
| 146026 | 2        | 3/23/15              | 3/27/15                  | BATTERY PLACE PUMP STATION     | 3/19/15           | 4/10/15        | Pull Pump #1 For Blockage  |
| 143320 | 2        | 4/10/15              | 4/10/15                  | SPRING CREEK PUMP STATION      | 1/15/15           | 4/15/15        | Pull floats up at station (Full of Grease) Copy to   |
|        |          |                      |                          |                                |                   |                | Electricians to check pressure Cell Install New Duo probe (TRIAD)                                      |
| 146180 | 2        | 3/24/15              | 4/6/15                   | SPRING CREEK PUMP STATION      | 3/23/15           | 4/15/15        | Replace all 3 Contactors   |
| 134865 | 2        | 7/8/14               | 8/19/14                  | TIFTONIA PUMP STATION #4       | 7/8/14            | 4/17/15        | Pump Megged Bad on 7-7-14 / Pull for repair COPY TO ELECTRICIANS FOR WIRING                            |
| 146932 | 2        | 4/10/15              | 4/10/15                  | CITICO CSOTF                   | 4/9/15            | 4/22/15        | Disinfect Chamber Miltronics has erratic readings and false overflow alarms (old style is at location) |
| 147013 | 2        | 4/13/15              | 4/13/15                  | WARNER PARK CSOTF              | 4/13/15           | 4/22/15        | replace filters (12) 20x24x2   |
| 139217 | 2        | 10/8/14              | 10/15/14                 | SOUTH CHICKAMAUGA PUMP STATION | 10/8/14           | 4/22/15        | HVAC not cooling   |
| 141290 | 2        | 11/18/14             | 3/23/15                  | WARNER PARK SS #2              | 11/20/14          | 4/22/15        | RTU Fail and surge suppressor not working  |
| 142802 | 2        | 3/26/15              | 3/31/15                  | LATTA STREET PUMP STATION      | 1/5/15            | 4/23/15        | Pump in Fail O&C not receiving ALARM   |
| 143215 | 2        | 3/31/15              | 3/31/15                  | 19TH STREET PUMP STATION       | 1/13/15           | 4/23/15        | no high drywell sump alarm   |
| 136762 | 2        | 3/11/15              | 3/11/15                  | TIFTONIA PUMP STATION #1       | 8/20/14           |                | repair conduit at bottom of platform   |
| 142575 | 2        | 2/11/15              | 2/11/15                  | CITICO CSOTF                   | 12/23/14          | 4/24/15        | Emergency lights have bare wire (SAFETY) See Monty   |
| 143228 | 2        | 3/9/15               | 3/25/15                  | WARNER PARK SS #2              | 1/13/15           | 4/24/15        | Pressure Transducer inop   |
| 142464 | 2        | 3/12/15              | 3/25/15                  | WARNER PARK SS #2              | 12/18/14          | 4/24/15        | LWW Float Inop   |

| ID     | Priority | Actual<br>Start Date | Finish              | Location                           | Initiated<br>Date | Closed<br>Date | Instructions  |
|--------|----------|----------------------|---------------------|------------------------------------|-------------------|----------------|---|
| 146960 | 2        | 4/11/15              | <b>Date</b> 4/11/15 | LAKE VISTA PUMP STATION            | 4/10/15           | 4/28/15        | Replace #2 Phase Monitor  |
| 146493 | 2        | 3/31/15              |                     | COLLEGEDALE PUMP STATION           | 3/31/15           |                | Clean Wetwell   |
| 147055 | 2        | 4/13/15              |                     | HIXSON PUMP STATION #1             | 4/13/15           |                | Check PLC for too many pump starts  |
| 147765 | 2        | 4/28/15              |                     | SOUTH CHICKAMAUGA PUMP STATION     | 4/27/15           |                | Replace/check drive room exhaust fan belts 2 (A37).                                 |
| 143929 | 2        | 4/20/15              | 4/20/15             | SOUTH CHICKAMAUGA PUMP STATION     | 1/27/15           | 4/29/15        | Repair drive Display on #4 Drive. Drive operating normally.                         |
| 143551 | 2        | 4/9/15               | 4/9/15              | TIFTONIA PUMP STATION #1           | 1/20/15           | 4/29/15        | Prob 1 Keeps showing in Fault (only way to keep Station Running)                    |
| 147386 | 2        | 4/27/15              | 4/27/15             | 19TH STREET CSOTF                  | 4/20/15           | 4/29/15        | Water running under door during rain event into MCC room.                           |
| 147499 | 2        | 4/24/15              | 4/24/15             | CARTER STREET CSOTF                | 4/21/15           | 4/29/15        | Odor control unit motor/fan is making a noise. Check belts.                         |
| 146731 | 2        | 4/23/15              | 4/23/15             | EASTGATE PUMP STATION #1           | 4/7/15            | 4/29/15        | Pressure transducer inop (Last occurred in 8/14)                                    |
| 147500 | 2        | 4/22/15              | 4/22/15             | ORCHARD KNOB PUMP STATION          | 4/21/15           | 4/29/15        | Replace belt A-49 and/or A6-510 in air compressor.                                  |
| 147496 | 2        | 4/22/15              | 4/22/15             | ORCHARD KNOB PUMP STATION          | 4/21/15           | 4/29/15        | Replace lights that are out on 2nd, 3rd, & bottom floor.                            |
| 147503 | 2        | 3/31/15              | 4/21/15             | COLLEGEDALE PUMP STATION           | 4/21/15           | 4/30/15        | Pull to check for blockages.  |
| 147456 | 2        | 4/21/15              | 4/21/15             | SOUTH CHICKAMAUGA PUMP STATION     | 4/20/15           |                | Check/replace belts (2B-59's) on odor control unit.                                 |
| 146933 | 2        | 4/9/15               | 4/9/15              | BIG RIDGE PUMP STATION #11         | 4/9/15            | 5/1/15         | Clean Wet Well  |
| 144399 | 2        | 4/28/15              | 4/29/15             | DUPONT PARKWAY PUMP STATION        | 2/5/15            | 5/1/15         | Flow meter vault sump pump trips breaker  |
| 146934 | 2        | 4/9/15               | 4/13/15             | Big Ridge Pump Station #1 Wet Well | 4/9/15            | +              | Clean Wet Well  |
| 139896 | 3        | 3/5/15               | 3/5/15              | EAST BRAINERD PUMP STATION         | 10/22/14          |                | Replace sump pump in Floor used for High Dry Well (COPY TO ELECTRICIANS FOR WIRING) |
| 143338 | 3        | 3/6/15               | 3/6/15              | ORCHARD KNOB STORM STATION         | 1/15/15           | 3/10/15        | Check High Creekside. Alarm has came in several times                               |
| 145427 | 3        | 3/7/15               | 3/7/15              | ORCHARD KNOB STORM STATION         | 3/5/15            | 3/10/15        | Check belt on Exhaust Fan (1) A44   |
| 143908 | 3        | 1/6/15               | 3/6/15              | WARNER PARK CSOTF                  | 1/27/15           | 3/11/15        | Still not fixed (SEE LUTHER)  |
| 145822 | 3        | 3/11/15              | 3/23/15             | HIXSON PUMP STATION #2             | 4/24/15           | 3/13/15        | repair intrusion alarm switch and operator assist                                   |

| ID     | Priority | Actual     | Actual   | Location                          | Initiated | Closed  | Instructions   |
|--------|----------|------------|----------|-----------------------------------|-----------|---------|--|
|        | -        | Start Date | Finish   |                                   | Date      | Date    |  |
|        |          |            | Date     |                                   |           |         |  |
| 143658 | 3        | 1/21/15    | 1/28/15  | CITICO PUMP STATION #2            | 1/21/15   | 3/13/15 | fan at top of stairwell and elevator room inop         |
| 144356 | 3        | 3/12/15    | 3/12/15  | 23rd STREET PUMP STATION          | 2/4/15    | 3/13/15 | Replace Toilet Hardware                                |
| 145226 | 3        | 3/2/15     | 3/2/15   | 27th STREET PUMP STATION          | 3/2/15    | 3/13/15 | Repair Floats  |
| 145588 | 3        | 3/11/15    | 3/11/15  | SOUTH CHICKAMAUGA PUMP STATION    | 3/9/15    | 3/13/15 | Check and replace lights as needed in whole station.   |
|        |          |            |          |                                   |           |         | report any with Ballast Problems                       |
| 145700 | 3        | 3/11/15    | 3/11/15  | ENTERPRISE SOUTH INDUSTRIAL PARK  | 3/11/15   | 3/13/15 | Change filters on New HVAC Unit (4) 16x16x2            |
| 145708 | 3        | 3/11/15    | 3/11/15  | TIFTONIA PUMP STATION #2          | 3/11/15   | 3/13/15 | Replace Low Float                                      |
| 140371 | 3        | 11/4/14    | 1/22/15  | TIFTONIA PUMP STATION #3          | 11/3/14   | 3/16/15 | Bearings on #2 Pump Motor slinging grease              |
| 145713 | 3        | 3/18/15    | 3/18/15  | MLK CSOTF                         | 3/11/15   | 3/24/15 | Repair seal around door from MCC to Wet Well           |
| 138754 | 3        | 1/9/15     | 2/18/15  | MT CREEK                          | 9/30/14   | 3/25/15 | Intrusion Alarm Inop, and Operator Assit in Wet Well   |
|        |          |            |          |                                   |           |         | goes in and out Switched from WRD Electrical to        |
|        |          |            |          |                                   |           |         | TRIAD 12/17/14   |
| 140265 | 3        | 2/18/15    | 2/18/15  | MT CREEK                          | 10/30/14  | 3/25/15 | Install Emergency Lights at Station (SEE BILL)         |
| 142547 | 3        | 2/18/15    | 2/18/15  | BIG RIDGE PUMP STATION #12        | 12/22/14  | 3/25/15 | Light Busted out                                       |
| 141846 | 3        | 2/18/15    | 2/18/15  | SOUTH CHICKAMAUGA PUMP STATION    | 12/4/14   | 3/25/15 | Emergency Lights on 3rd floor not working              |
| 146056 | 3        | 3/20/15    | 3/20/15  | CITICO PUMP STATION #2            | 3/20/15   | 3/26/15 | Repair Broken Drain Line                               |
| 145425 | 3        | 3/9/15     | 3/9/15   | ALTAMONT PUMP STATION             | 3/5/15    | 3/27/15 | Clean Wetwell  |
| 145329 | 3        |            |          | WARNER PARK CSOTF                 | 3/4/15    | 3/27/15 | Clean fine screen at CSO                               |
| 145330 | 3        |            |          | BRAINERD GOLF COURSE PUMP STATION | 3/4/15    | 3/27/15 | Clean Wet well at Golf Course                          |
|        |          |            |          |                                   |           |         |  |
| 145429 | 3        | 3/6/15     | 3/6/15   | COLLEGEDALE PUMP STATION          | 3/5/15    | 3/27/15 | Clean wetwell  |
| 145420 | 3        | 3/12/15    | 3/12/15  | ORCHARD KNOB PUMP STATION         | 3/5/15    | 3/27/15 | Clean wetwell  |
| 141531 | 3        | 11/25/14   | 11/25/14 | SOUTH CHICKAMAUGA PUMP STATION    | 11/26/14  | 3/27/15 | Clean Wetwell  |
| 145958 | 3        | 3/17/15    | 3/17/15  | BIG RIDGE PUMP STATION #5         | 3/17/15   | 3/30/15 | Clean Wetwell  |
| 114425 | 3        | 5/16/13    | 11/5/14  | CENTRAL AVENUE CSOTF              | 5/31/13   | 4/6/15  | written to capture time on bush hogging fields for the |
|        |          |            |          |                                   |           |         | mowing season (To remain open until last mowwing )     |
|        |          |            |          |                                   |           |         |  |

| ID     | Priority | Actual<br>Start Date | Actual<br>Finish<br>Date | Location                       | Initiated<br>Date | Closed<br>Date | Instructions   |
|--------|----------|----------------------|--------------------------|--------------------------------|-------------------|----------------|--|
| 122190 | 3        | 10/15/13             | 12/3/14                  | TIFTONIA PUMP STATION #1       | 10/15/13          |                | -INSTALLATION OF TWO EIGHT INCH SUBMERSIBLE PUMPS - AND ONE HYDRAULIC POWER UNIT SKID MOUNTED DIESEL DRIVE FOR THE TIFTONIA #1 PUMP STATION parts in 5/22/14 |
|        |          |                      |                          |                                |                   |                | CONCRETE- YEARBEY ELECTRICAL- TRIAD CONSTRUCTION- H&H TEMP. BYPASS- RAIN4RENT  |
| 144714 | 3        | 2/13/15              | 3/19/15                  | CITICO PUMP STATION #2         | 2/13/15           | 4/7/15         | Repack pump #1   |
| 145960 | 3        | 3/17/15              | 3/17/15                  | DUPONT INDUSTRIAL PARK         | 3/17/15           | 4/7/15         | Replace Discharge Isolation Valve Handles on Both pumps  |
| 130481 | 3        | 8/26/14              | 8/26/14                  | CITICO CSOTF                   | 4/4/14            | 4/8/15         | Emergency Light in screening area has no bulbs, May need to be replaced (Safety)   |
| 139099 | 3        | 10/7/14              | 10/7/14                  | TIFTONIA PUMP STATION #2       | 10/7/14           | 4/9/15         | Light in Tube out (60 W) need new style LED for panel  |
| 139827 | 3        | 10/21/14             | 10/21/14                 | TIFTONIA PUMP STATION #4       | 10/21/14          | 4/9/15         | Check and or replace heat tape   |
| 140922 | 3        | 11/12/14             | 11/12/14                 | WILLIAMS STREET CSOTF          | 11/12/14          | 4/9/15         | Check duct heater at station   |
| 141923 | 3        | 4/9/15               | 4/9/15                   | SOUTH CHICKAMAUGA PUMP STATION | 12/5/14           | 4/9/15         | #4 Pump o-ring seal leaking  |
| 144130 | 3        | 1/30/15              | 1/30/15                  | SPRING CREEK PUMP STATION      | 1/30/15           | 4/9/15         | Replace GFI Receptacle and plate in Flow Meter Box   |
| 145854 | 3        | 3/13/15              | 3/13/15                  | TIFTONIA PUMP STATION #3       | 3/13/15           | 4/9/15         | Replace light at top of tube.  |
| 146423 | 3        | 3/27/15              | 3/27/15                  | BIG RIDGE PUMP STATION #9      | 3/27/15           | 4/9/15         | Float makes then will not stay made unless shaken  |
| 146426 | 3        | 3/27/15              | 3/27/15                  | CITICO PUMP STATION #2         | 3/27/15           |                | Wire nut exposed unused wires on Roll up door in Rake Room. (Using Manual operation on door.)  |
| 145966 | 3        | 4/1/15               | 4/1/15                   | DUPONT PARKWAY PUMP STATION    | 3/17/15           | 4/9/15         | Wash down Valve leaking by   |

| ID     | Priority | Actual<br>Start Date | Actual<br>Finish<br>Date | Location                       | Initiated<br>Date | Closed<br>Date | Instructions   |
|--------|----------|----------------------|--------------------------|--------------------------------|-------------------|----------------|--|
| 141552 | 3        | 3/30/15              | 4/8/15                   | SOUTH CHICKAMAUGA PUMP STATION | 11/26/14          | 4/10/15        | Change odor control filters and clean screen                                   |
| 73970  | 3        | 8/15/11              |                          | SOUTH CHICKAMAUGA PUMP STATION | 8/17/11           |                | PROGRAM PLC'S  |
| 142808 | 3        | 4/2/15               | 4/2/15                   | SOUTH CHICKAMAUGA PUMP STATION | 1/5/15            | 4/14/15        | Set Pump Speeds to run at max when miltronics backup kicks in                  |
| 143874 | 3        | 4/8/15               | 4/8/15                   | 19TH STREET PUMP STATION       | 1/26/15           |                | Replace Busted cover on Eaton Crouse Hinds Light fixture style FVS20S753       |
| 143876 | 3        | 4/7/15               | 4/7/15                   | CITICO PUMP STATION #2         | 1/26/15           | 4/15/15        | Replace Light Fixture Cover over elevator in Drywell                           |
| 145857 | 3        | 4/15/15              | 4/15/15                  | CITICO PUMP STATION #2         | 3/13/15           | 4/17/15        | Water leak @ sluice gate   |
| 146495 | 3        | 3/31/15              | 3/31/15                  | EAST BRAINERD PUMP STATION     | 3/31/15           |                | Check Pump 2 & 3 for blockage after #1 is put back. (Record time on each pump) |
| 146541 | 3        | 4/6/15               | 4/6/15                   | SOUTH CHICKAMAUGA PUMP STATION | 4/1/15            | 4/17/15        | Replace wiper on rake bar  |
| 146671 | 3        | 4/10/15              | 4/10/15                  | CARTER STREET CSOTF            | 4/6/15            | 4/22/15        | Repace lights over portable odor Control                                       |
| 146712 | 3        | 4/8/15               | 4/8/15                   | EAST BRAINERD PUMP STATION     | 4/7/15            | 4/22/15        | Repair Bubble line. (Contractor broke it)                                      |
| 146734 | 3        | 4/9/15               | 4/9/15                   | FRIAR BRANCH PUMP STATION      | 4/7/15            | 4/22/15        | Install ear plug dispenser for SAFETY  |
| 137224 | 3        | 11/7/14              | 4/13/15                  | BIG RIDGE PUMP STATION #1      | 8/29/14           |                | Run Piping Necessary for operation of bypass pump WORKING ON DIMENSIONS        |
| 139030 | 3        | 3/31/15              | 3/31/15                  | 23rd STREET PUMP STATION       | 10/6/14           | 4/22/15        | Operator assist inop and no High Drywell Alarm                                 |
| 139892 | 3        | 3/26/15              | 3/26/15                  | LATTA STREET PUMP STATION      | 10/22/14          | 4/22/15        | Secure breaker panels in MCC   |
| 143466 | 3        | 3/9/15               | 3/19/15                  | BATTERY PLACE PUMP STATION     | 1/16/15           |                | Rebuild Control Panel and include Hour Meters for pumps                        |
| 143829 | 3        | 2/24/15              | 3/19/15                  | STORM STATION #1               | 1/23/15           |                | Replace lights around pumps and up top (LED IF POSSIBLE)                       |
| 144681 | 3        | 3/12/15              | 3/19/15                  | HIXSON PUMP STATION #2         | 2/12/15           |                | Locate underground Electrical from Tube to Fence See MATT S.                   |
| 144985 | 3        | 3/24/15              | 3/24/15                  | SOUTH CHICKAMAUGA PUMP STATION | 2/23/15           | 4/23/15        | Add Circuits for Nitrogen Backup (SEE TRAVIS)                                  |
| 145009 | 3        | 2/27/15              | 4/14/15                  | STORM STATION #2               | 2/23/15           | 4/23/15        | Install hand rail above bar screen   |
| 130832 | 3        | 1/12/15              | 3/9/15                   | CENTRAL AVENUE CSOTF           | 4/11/14           | 4/23/15        | Generator Room Light Above Control Room is Out.                                |
| 131991 | 3        | 3/6/15               | 3/6/15                   | WARNER PARK SS #2              | 5/6/14            | 4/23/15        | Install an Operator Assist Button  |

| ID     | Priority | Actual     | Actual  | Location                                | Initiated | Closed  | Instructions  |
|--------|----------|------------|---------|---|-----------|---------|---|
|        |          | Start Date | Finish  |   | Date      | Date    |   |
|        |          |            | Date    |   |           |         |   |
| 137076 | 3        | 2/25/15    | 3/13/15 | 23rd STREET PUMP STATION                | 8/27/14   | 4/23/15 | Conduit elbow broken in room where distribution box   |
|        |          |            |         |   |           |         | is SEE Keith  |
| 138831 | 3        | 10/1/14    | 3/11/15 | 19TH STREET PUMP STATION                | 10/1/14   | 4/24/15 | Operator Assist in Wet Well Inop                      |
| 143813 | 3        | 1/26/15    | 3/25/15 | CITICO PUMP STATION #2                  | 10/1/14   | 4/24/15 | door inop   |
| 139520 | 3        | 2/18/15    | 3/12/15 | DUPONT PARKWAY PUMP STATION             | 10/15/14  | 4/24/15 | Testing of Circuit Breakers                           |
| 142469 | 3        | 3/6/15     | 3/10/15 | WARNER PARK SS #2                       | 12/18/14  | 4/24/15 | Install Intrusion Alarm                               |
| 143362 | 3        | 3/19/15    | 4/2/15  | LATTA STREET PUMP STATION               | 1/15/15   | 4/24/15 | Heater is not working                                 |
| 135729 | 3        | 2/13/15    | 3/13/15 | HIGHLAND PARK PUMP STATION              | 7/28/14   | 4/24/15 | Check Pump 3 for Blockage                             |
|        |          |            |         |   |           |         | H&H to pull pump because it is stuck                  |
| 145304 | 3        | 3/3/15     | 4/6/15  | SPRING CREEK PUMP STATION               | 3/3/15    | 4/24/15 | Switch out pumps                                      |
| 145419 | 3        | 3/12/15    | 3/19/15 | WARNER PARK SS #1                       | 3/5/15    | 4/28/15 | Clean Bar Screen                                      |
| 146032 | 3        | 3/20/15    | 3/20/15 | BIG RIDGE PUMP STATION #11              | 3/19/15   | 4/28/15 | Clean Wetwell   |
| 146930 | 3        | 4/10/15    | 4/10/15 | BIG RIDGE PUMP STATION #2               | 4/9/15    | 4/28/15 | #2 pump tripped breaker                               |
| 144474 | 3        | 2/6/15     | 2/6/15  | Tiftonia Pump Station #3 Wet Well Alarm | 2/6/15    | 4/29/15 | No High Wet Well Alarm                                |
| 146031 | 3        | 4/8/15     | 4/9/15  | HERITAGE GREEN PUMP STATION             | 3/19/15   | 4/29/15 | Clean Wetwell   |
| 147418 | 3        | 4/22/15    | 4/30/15 | MURRAY HILLS #5                         | 4/20/15   | 4/30/15 | Seal water gate valve needs replacing. Luther did not |
|        |          |            |         |   |           |         | mention any particular pump on the request sheet.     |
|        |          |            |         |   |           |         |   |
| 146543 | 3        | 4/21/15    | 4/21/15 | ROSS LANDING CSOTF                      | 4/1/15    | 5/1/15  | Replace belts #1 Exhaust Fan (BX51 4each)             |
| 145632 | 3        | 3/10/15    | 4/14/15 | CITICO PUMP STATION #2                  | 3/10/15   | 5/6/15  | Will not come on. (Makes humming noise)               |
| 139032 | 3        | 1/14/15    | 2/13/15 | COLLEGEDALE PUMP STATION                | 10/6/14   | 5/6/15  | Bubble line inop. may be plugged. Electrician         |
|        |          |            |         |   |           |         | troubleshot bubble line. Need to replace bubble line. |
|        |          |            |         |   |           |         |   |